



DAM BUSTER®

Achieve Compliance & Conformance with **Dam Buster® Products**


NOTE: All Dam Buster® products are protected by various Australian & International Patents.



QUICK DESIGN GUIDE

Version 5.0 (01 July 2026)

Refer to the Product Technical Statement for the
full design information

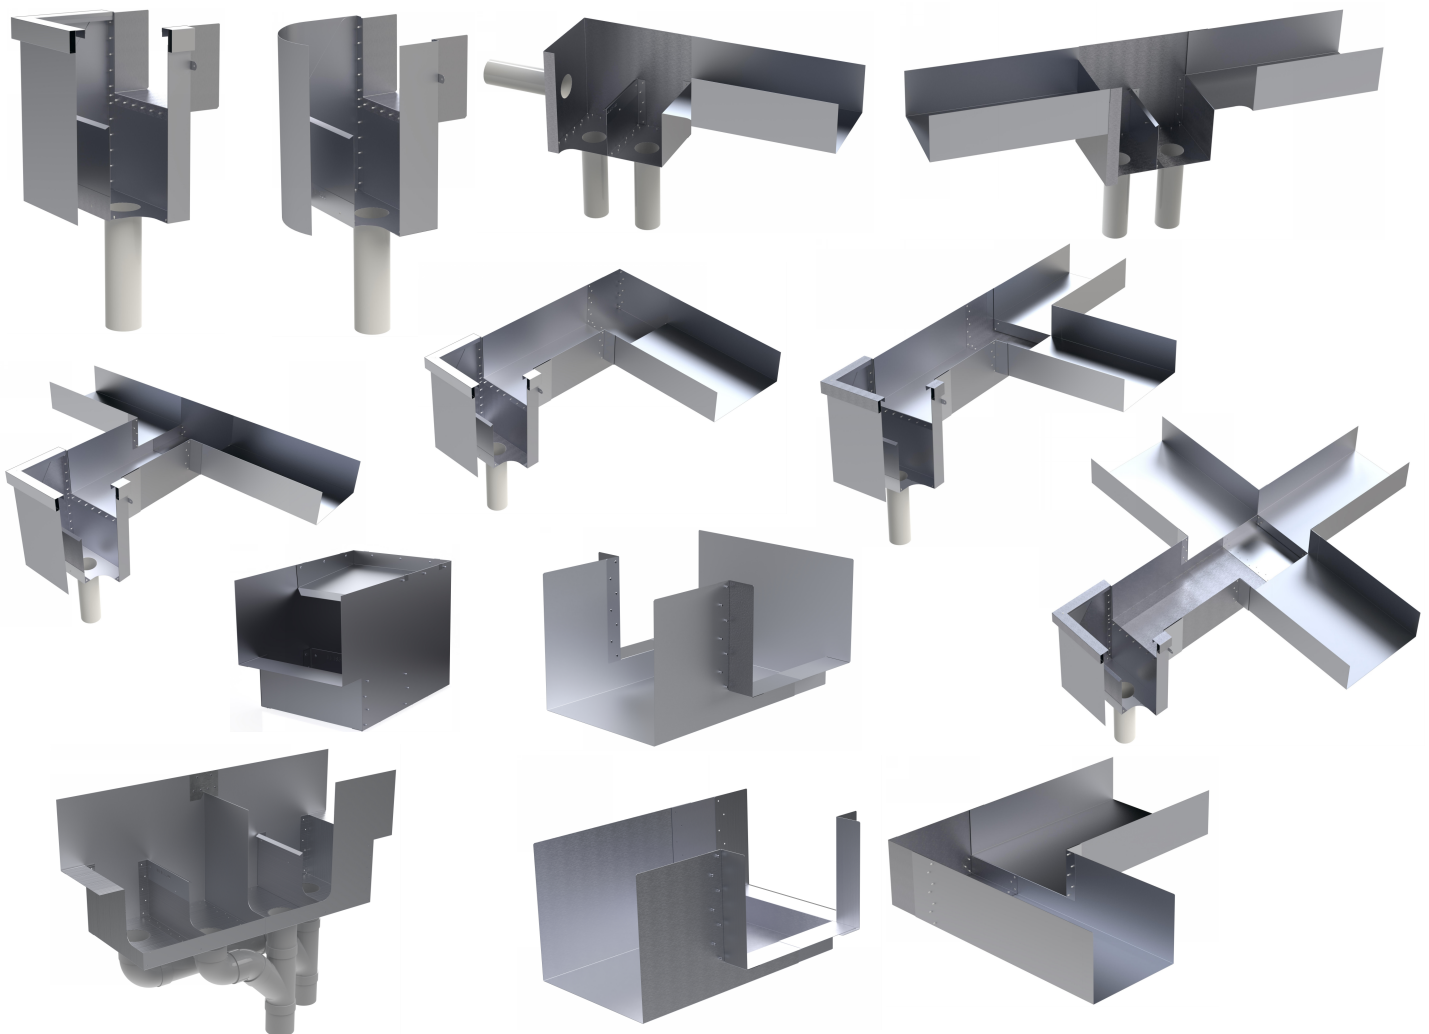

CERTIFIED PRODUCT (DAM BUSTER RAINHEAD)

For testing the Overflow Performance
of Dam Buster rectangular rainheads.



**GOOD
DESIGN
AWARD®**
WINNER 2018

PRODUCT DESIGN
HARDWARE AND BUILDING
DAM BUSTER
RAINHEAD

"The Architectural Choice"

www.dambuster.com.au



<u>Item</u>	<u>Page(s)</u>
Compliance with the NCC	3
Design process	3
1 – Determination of the design rainfall intensity	4, 5
2 – Determine of the design flowrate for each box gutter	6
Example for calculating the catchment area and	
design flow rate for a box gutter	7
3 – Design of the box gutters	8
– Dam Buster box gutter design charts – 1 in 200 slope	9
– 1 in 150 slope	10
– 1 in 100 slope	11
– 1 in 40 slope	12
4 – Selection of Box Gutter Overflow Devices / DP combinations:	
(a) Rainheads	13
(b) Sumps	14
(c) Side Outlets	15
5 – Design of Box Gutters & Upstream Devices	
(i) Elbows	16
(ii) Junctions	17
Design strategy for volume builder homes	18,19
Design charts for aerial downpipes	20
Design examples - T Side Outlet and Rainhead combination	22
- Free flow Sump	22
- Example including upstream devices	23
Dam Buster Products Names	24
- Rainhead types	25
- Flashing kits for wall flashings	26
Performance Solution Process & Documentation	27
Product Data Sheets	28-43
Selected Dam Buster Standard drawing details	44-62

COMPLIANCE WITH THE NCC

Refer to the Dam Buster '[Evidence of Suitability](#)' document for details of the compliance methods for the Dam Buster roof drainage system. If required, carry out the Performance Solution process, refer page 27 for a summary of this process.

DESIGN PROCESS USING DAM BUSTER BOX GUTTER DEVICES

A- Determination of the design flow rates to each box gutter

A1 - Determination of design rainfall intensity

A2 - Determination of the design flow rate in L/s to each box gutter

B- Design of Box Gutters & Box Gutter Overflow Devices

- Rainheads,
- Side Outlet & Rainhead combinations,
- Side Outlet & Sump combinations,
- Sumps,
- Continuous Sumps &
- Back-to-Back Sumps

B1 - Design of box gutters discharging to a Dam Buster device

B2 - Use the Dam Buster flow rate charts to select the device size and downpipe (DP) combinations

C - Design of Box Gutters & Upstream devices

C1- Design of Elbows (including box gutters) in accordance with the specific design procedure

C2 - Design of Junctions (including box gutters) in accordance with the specific design procedure

A1 - Determination of the design rainfall intensity

= 1% AEP rainfall event ie. 100 year ARI for box gutters

Method 1

Look up the nearest area in Table D.1, AS/NZS 3500.3-2021

NOTE - 1% AEP = 100 year ARI
ARI = Average Recurrence Interval
AEP= Annual Exceedance Probability

Example below - 1%AEP = 187 mm /h = 100I5*

* Note - 100 refers 100 years, I refers to Intensity, and
5 refers to 5 minutes = time of concentration
Note- the maximum 5 min consecutive rainfall
multiplied by 12 to convert to mm/hour

Australian location	Latitude	Longitude	5% AEP (20 years ARI) Intensity mm/h	1%AEP (100 years ARI) Intensity Mm/h
Melbourne:				
Craighburn	35.79	144.94	128	186
Dandenong	37.99	145.21	133	181
Frankston	38.14	145.11	123	165
Hastings	38.31	145.19	112	145
Melbourne City	37.81	144.96	132	187
Oakleigh	37.89	145.09	132	182
Portsea	38.31	144.71	106	140
Sunbury	37.59	144.74	122	171
Sunshine	37.79	144.84	131	186
Warrandyte	37.74	145.21	126	172


Values obtained from Table D1 of AS/NZS 3500.3-2021

Method 2

Use the BOM's IFD website - MORE ACCURATE

- a) Determine the Latitude & Longitude for the site address eg
Using Google Earth, right click on the location pin EXAMPLE

LAT = -37.81335
LONG = 144.96327

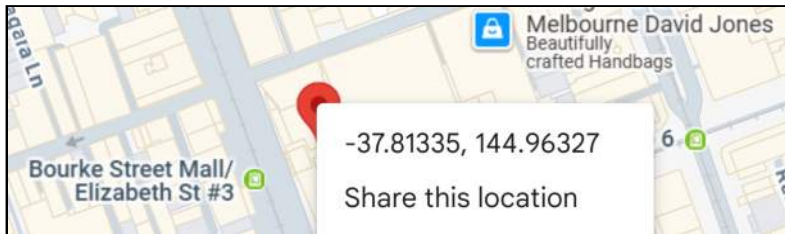

- b) Use the BOM's Intensity-Frequency-Duration (IFD) website
<http://www.bom.gov.au/water/designRainfalls/revised-ifd/>

Design Rainfall Data System (2016) [Conditions of Use](#) | [Help](#) | [New IFD feedback](#)

Search

☒ **Single Point**

☒ **Decimal degrees**

Latitude:

Longitude:

☐ Degrees, Minutes, Seconds

☐ Easting, Northing, Zone

Label:

About the 2016 Design Rainfalls

The 2016 design rainfalls provided here are:

- based on a more extensive database, with more than 30 years of additional rainfall data and data from extra rainfall stations;
- more accurate estimates, combining contemporary statistical analysis and techniques with an expanded rainfall database; and
- better estimates of the 2% and 1% annual exceedance probability design rainfalls than the interim 2013 IFDs.

By combining contemporary statistical analyses and techniques with an expanded database, the 2016 design rainfalls provide more accurate design rainfall estimates for Australia.

Note: The 2016 IFDs replace both the ARR87 IFDs and the interim 2013 IFDs.

The ARR 87 IFDs will be available [here](#) until June 2020.

Location

Label: Not provided

Latitude: -37.8134 [Nearest grid cell: 37.8125 (S)]

Longitude: 144.9633 [Nearest grid cell: 144.9625 (E)]



IFD Design Rainfall Intensity (mm/h) Issued: 26 January 2025

Rainfall intensity for Durations, Exceedance per Year (EY), and Annual Exceedance Probabilities (AEP). [FAQ for New ARR probability terminology](#)

Unit:

Duration	Annual Exceedance Probability (AEP)						
	63.2%	50%#	20%*	10%	5%	2%	1%
1 min	93.1	105	144	175	208	256	298
2 min	79.5	88.6	120	143	169	205	236
3 min	71.3	79.5	108	129	153	186	214
4 min	65.0	72.7	99.1	119	141	172	199
5 min	60.1	67.3	92.1	111	132	161	187

1% AEP = 187mm/h

A2 - Determination of the design flow rate

Design Flow Rate, $Q = \frac{CA \times 1\% \text{ AEP}}{3600}$

1% AEP= Design rainfall intensity in mm/hour

Q= Design flow rate in L/s

CA = Catchment area (m^2)
= Plan area + $\frac{1}{2}$ x nett vertical area (from the most critical direction).

Notes


- 1) 1 mm of rainfall over 1m^2 equates to 1 litre.
- 2) Dividing the 1% AEP by 3600 changes the units from L/hour to L/second.

Example

CA= 120m^2
1% AEP= 195mm/h
Q= $\frac{120 \times 195}{3600} = 6.5 \text{ L/s}$

Monoslope (single sloping) roofs

Note, for monoslope roofs, the catchment area can be determined using a multiplier, **F**, referred to as the **Catchment area multiplier**, which is tabulated in Table 3.4.3.2 AS/NZS 3500.3-2021. The derivation of this factor is shown below, and it can also be calculated directly from the roof slope. This calculation is more useful for higher pitched roofs, commonly having eaves gutters. For 'flat' roofs, the factor is small. For example, for a 2 DEG roof pitch the $F = 1.02$. Furthermore, the net vertical area should be considered. For a 2 DEG roof, the net vertical area between the ridge and the top of the parapet wall may be close to zero, in which case the factor **F** does not apply.

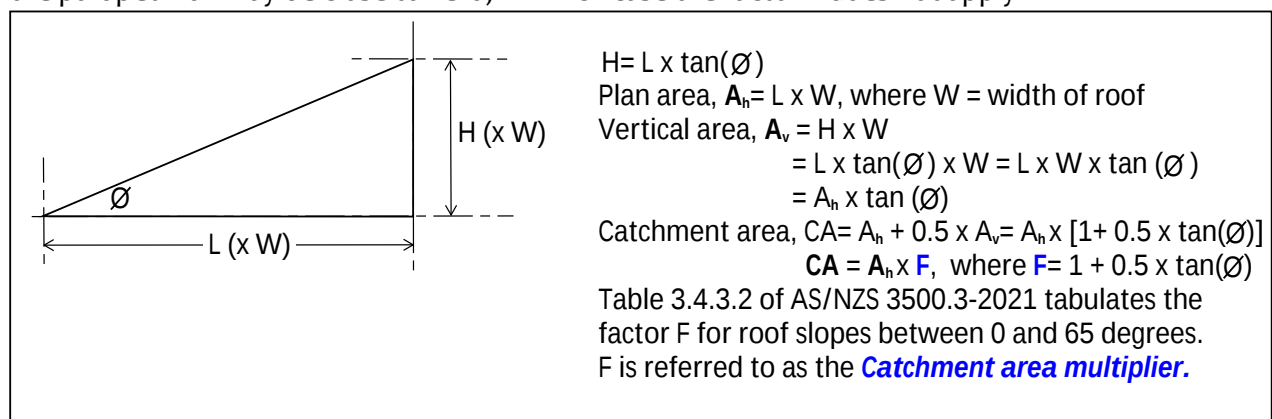

Derivation of the **Catchment area multiplier (F)** in Table 3.4.3.2 of AS/NZS 3500.3 for single sloping roofs

Minimum design flow rate – 3.0 L/s

Dam Buster adopts a minimum design flow rate of 3.0 L/s for each box gutter. This approach is in accordance with the AHSCA Research Foundation discussion paper by A/Prof Terry Lucke titled 'Box Gutter Design Using General Methods of AS/NZS 3500.3:2018 Minimum Flowrates and Gutter Depths.


Example

Dam Buster T Side Outlet and Rainhead combination.

LH gutter = 1.5 L/s, RH gutter = 5.0 L/s.

- ⇒ Design the LH gutter for 3.0 L/s and the RH gutter for 5.0 L/s
- ⇒ However, design the rainhead & DP for 6.5 L/s (not $3.0 + 5.0 = 8.0 \text{ L/s}$).

Example

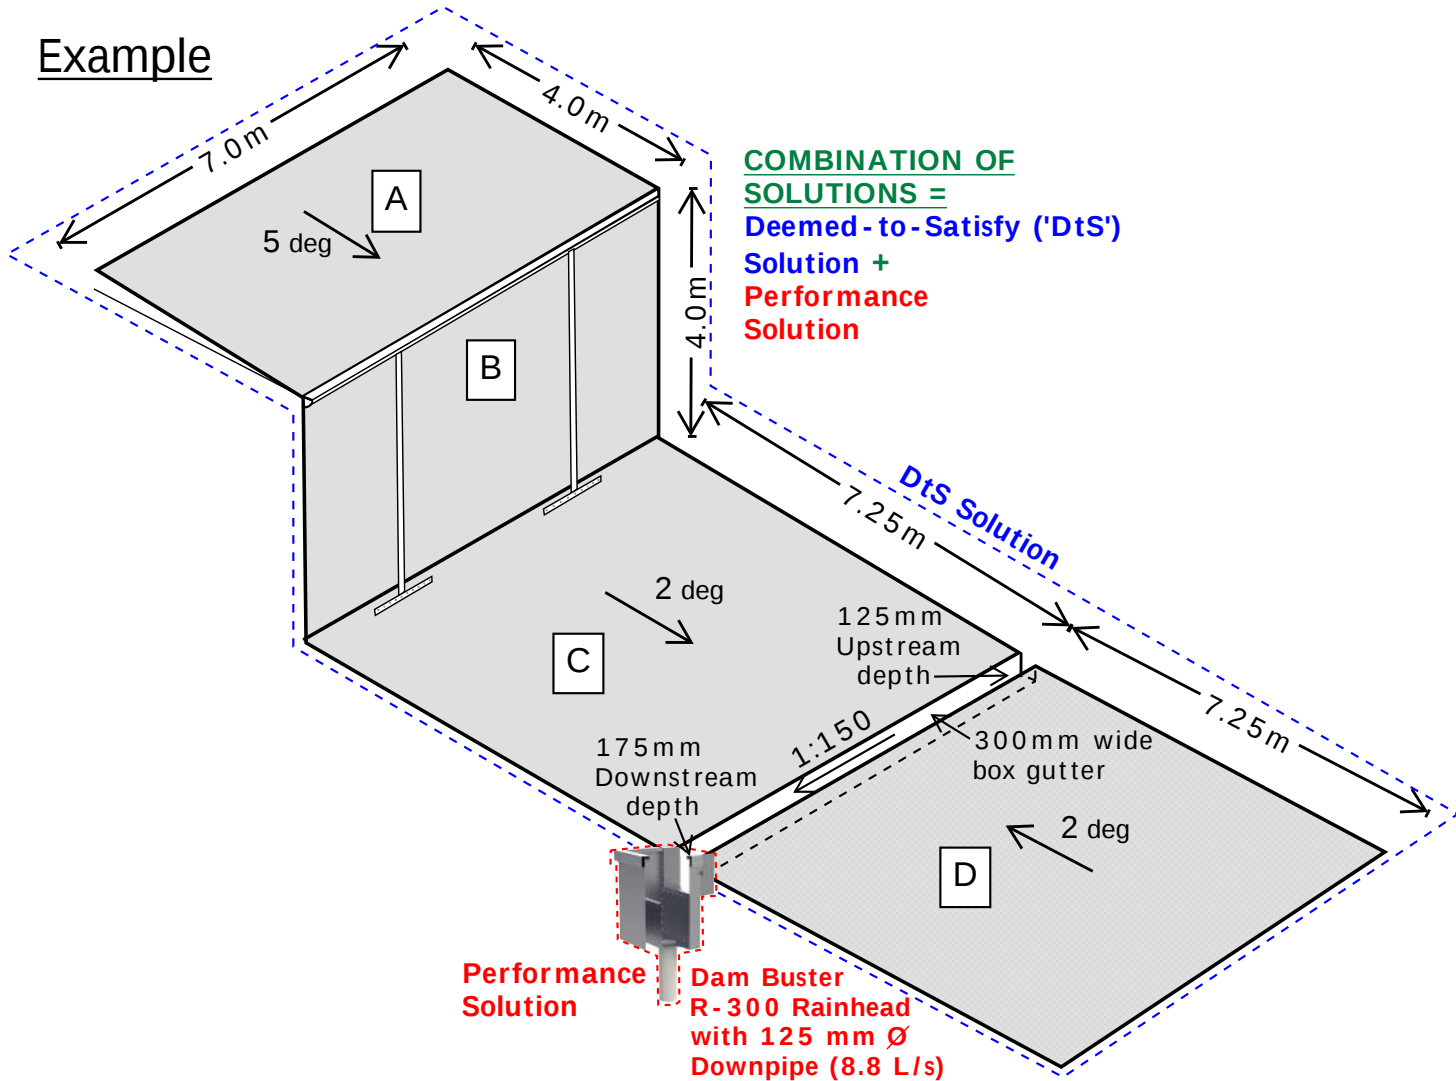

Catchment area = plan area + (1/2) x net vertical area

Roof A

Roof area 'A' = $7.0 \times 4.0 = 28.0\text{m}^2$

Catchment area = 'A' x F = $28 \times 1.04 = \mathbf{29.1\text{m}^2}$

where $F = 1 + 0.5 \times \tan(\text{slope}) = 1 + 0.5 \times \tan(5^\circ) = 1.04$

Note, F is also given in Table 3.4.3.2 of AS/NZS 3500.3-2021

Wall B

Wall area 'B' = $7.0 \times 4.0 = 28.0\text{m}^2$

Catchment area = $1/2 \times 28.0 = \mathbf{14.0\text{m}^2}$

Roofs C & D

Roof area = $2 \times 7 \times 7.25 = 101.5\text{m}^2$

Note, the vertical component of roofs C & D cancel each other.

Total Catchment area = $29.1 + 14.0 + 101.5 = \mathbf{144.6\text{m}^2}$

Design flow rate

Design flow rate, $Q = (CA \times 1\% \text{ AEP}) / 3600$
 $= (144.6 \times 195) / 3600$
 $= \mathbf{7.83 \text{ litres / sec}}$

SELECTION - Dam Buster R-300 Rainhead with 125mm Diam. DP
 (Allowable flow rate = $8.8 \text{ L/s} > 7.83 \text{ L/s}$)

B - Design of box gutters & box gutter overflow devices

Design Notes

- 1) As all box gutters discharging to Dam Buster devices are 'free flow' in both the normal and overflow conditions, all box gutters can therefore be designed in accordance with Figure H.1 of AS/NZS 3500.3-2021.
- 2) However, Dam Buster has tabulated Figure H1 for each of the following 4 slopes:- 1 in 200, 1 in 150, 1 in 100 & 1 in 40
- 3) Dam Buster adopts a minimum design flow rate of 3.0L/s
- 4) The design depth is the minimum UPSTREAM depth and the box gutter depth must increase towards the downstream end as follows:

1 in 200 slope => 5 mm per m

1 in 150 slope => 7mm approx. per m (actually 6.7mm per m)

1 in 100 slope => 10mm approx. per m

1 in 40 slope = > 25mm per m
- 5) Whilst a slope of 1 in 200 is allowable, Dam Buster recommends a greater slope (eg 1 in 150 or 1 in 100) be adopted, particularly for:-
 - Reactive clay sites, where differential footing movements are more likely to occur
 - Timber framed roofs - long term creep deflections may also result in loss of fall.

NOTE

Box gutters associated with Upstream Dam Buster devices (Elbows and Junctions) are designed slightly differently to box gutters discharging to overflow devices. Refer pages 15 & 16 for the design procedure.

B1 - Design of box gutters discharging to Dam Buster box gutter overflow devices

Select the minimum upstream box gutter depth from one of the charts below.

Design chart for box gutters discharging to Dam Buster free flow devices

IMPORTANT - DO NOT USE for the following Dam Buster DtS devices:

SSO – Sump and Side Overflow

HCO – High-Capacity Overflow

Minimum UPSTREAM box gutter depth (mm) for **1 in 200*** slope

* 1:200 slope equates to **5mm per m increasing depth** over the length of the gutter

Design flow rate L/s	Example Box gutter width (mm)								
	200	250	300	350	400	450	500	550	600
3.0	107	101	96	93	90	88	86	84	83
3.5	113	105	100	96	93	91	89	87	85
4.0	118	110	104	100	96	94	91	89	88
4.5	122	114	107	103	99	96	94	92	90
5.0	127	118	111	106	102	99	96	94	92
5.5	131	121	114	109	105	101	99	96	94
6.0	135	125	118	112	107	104	101	98	96
6.5	140	129	121	115	110	106	103	101	98
7.0	144	132	124	118	113	109	105	103	100
7.5	148	135	127	120	115	111	107	105	102
8.0	151	139	130	123	118	113	110	107	104
8.5	155	142	133	125	120	115	112	108	106
9.0	159	145	135	128	122	118	114	110	107
9.5	162	148	138	131	125	120	116	112	109
10.0	166	151	141	133	127	122	118	114	111
10.5	170	154	144	135	129	124	119	116	113
11.0		157	146	138	131	126	121	118	114
11.5		160	149	140	133	128	123	119	116
12.0		163	151	142	135	130	125	121	118
12.5		166	154	145	137	132	127	123	119
13.0		169	156	147	140	134	129	124	121
13.5			159	149	142	135	130	126	122
14.0			161	151	144	137	132	128	124
14.5			164	154	146	139	134	129	125
15.0			166	156	148	141	135	131	127
15.5			168	158	149	143	137	132	128
16.0				160	151	144	139	134	130

Example

300mm wide box gutter

Flow rate = 6.0 L/s

=> Minimum UPSTREAM depth = 118mm

Recommend rounding up to nearest 5mm => Adopt 120mm UPSTEAM depth

B1 - Design of box gutters discharging to Dam Buster box gutter overflow devices (cont.)

Design chart for box gutters discharging to Dam Buster free flow devices

IMPORTANT - DO NOT USE for the following Dam Buster DtS devices:

SSO – Sump and Side Overflow

HCO – High-Capacity Overflow

Minimum UPSTREAM box gutter depth (mm) for **1 in 150*** slope

* 1:150 equates to **7mm approx. per m** increasing depth over the length of the gutter

Design flow rate L/s	Example Box gutter width (mm)								
	200	250	300	350	400	450	500	550	600
3.0	104	98	94	90	88	86	84	82	81
3.5	109	102	97	94	91	88	87	85	83
4.0	113	106	101	97	94	91	89	87	86
4.5	118	110	104	100	96	94	91	89	88
5.0	122	113	107	103	99	96	94	92	90
5.5	126	117	110	105	102	98	96	94	92
6.0	130	120	113	108	104	101	98	96	94
6.5	134	124	116	111	106	103	100	98	95
7.0	138	127	119	113	109	105	102	99	97
7.5	141	130	122	116	111	107	104	101	99
8.0	145	133	125	118	113	109	106	103	101
8.5	148	136	127	121	116	111	108	105	102
9.0	152	139	130	123	118	113	110	107	104
9.5	155	142	133	125	120	115	112	108	106
10.0	158	145	135	128	122	117	113	110	107
10.5	162	148	138	130	124	119	115	112	109
11.0		150	140	132	126	121	117	113	110
11.5		153	142	134	128	123	119	115	112
12.0		156	145	136	130	125	120	117	113
12.5		158	147	139	132	126	122	118	115
13.0		161	149	141	134	128	124	120	116
13.5			152	143	136	130	125	121	118
14.0			154	145	138	132	127	123	119
14.5			156	147	139	133	128	124	121
15.0			158	149	141	135	130	126	122
15.5			161	151	143	137	132	127	123
16.0				153	145	138	133	129	125

Example

300mm wide box gutter

Flow rate = 6.0 L/s

=> Minimum UPSTREAM depth = 113mm

Recommend rounding up to nearest 5mm => Adopt 115mm UPSTREAM depth

B1 - Design of box gutters discharging to Dam Buster box gutter overflow devices (cont.)

Design chart for box gutters discharging to Dam Buster free flow devices

IMPORTANT - DO NOT USE for the following Dam Buster DtS devices:

SSO – Sump and Side Overflow

HCO – High-Capacity Overflow

Minimum UPSTREAM box gutter depth (mm) for **1 in 100*** slope

* 1:100 slope equates to **10mm per m** increasing depth over the length of the gutter

Design flow rate L/s	Example Box gutter width (mm)								
	200	250	300	350	400	450	500	550	600
3.0	102	96	92	89	86	84	83	81	80
3.5	106	100	95	92	89	87	85	83	82
4.0	110	103	98	95	92	89	87	86	84
4.5	115	107	102	98	94	92	90	88	86
5.0	119	110	105	100	97	94	92	90	88
5.5	122	114	108	103	99	96	94	92	90
6.0	126	117	110	106	102	98	96	94	92
6.5	130	120	113	108	104	101	98	96	94
7.0	133	123	116	110	106	103	100	97	95
7.5	137	126	119	113	108	105	102	99	97
8.0	140	129	121	115	110	107	103	101	98
8.5	143	132	124	117	113	109	105	102	100
9.0	147	135	126	120	115	110	107	104	102
9.5	150	137	129	122	117	112	109	106	103
10.0	153	140	131	124	119	114	110	107	105
10.5	156	143	133	126	120	116	112	109	106
11.0		145	136	128	122	118	114	110	108
11.5		148	138	130	124	119	115	112	109
12.0		150	140	132	126	121	117	113	110
12.5		153	142	134	128	123	119	115	112
13.0		155	144	136	130	124	120	116	113
13.5			147	138	131	126	122	118	115
14.0			149	140	133	128	123	119	116
14.5			151	142	135	129	125	121	117
15.0			153	144	137	131	126	122	119
15.5			155	146	138	132	128	123	120
16.0				148	140	134	129	125	121

Example

300mm wide box gutter

Flow rate = 6.0 L/s

=> Adopt 110mm UPSTREAM depth

B1 - Design of box gutters discharging to Dam Buster box gutter overflow devices (cont.)

Design chart for box gutters discharging to Dam Buster free flow devices

IMPORTANT - DO NOT USE for the following Dam Buster DtS devices:

SSO – Sump and Side Overflow

HCO – High-Capacity Overflow

Minimum UPSTREAM box gutter depth (mm) for **1 in 40*** slope

* 1:40 slope equates to **25mm per m** increasing depth over length of the gutter

Design flow rate L/s	Example Box gutter width (mm)								
	200	250	300	350	400	450	500	550	600
3.0	93	88	85	83	81	79	78	77	76
3.5	96	91	88	85	83	81	80	78	77
4.0	100	94	90	87	85	83	82	80	79
4.5	103	97	93	90	87	85	83	82	81
5.0	106	100	95	92	89	87	85	83	82
5.5	109	102	97	94	91	89	87	85	84
6.0	112	105	100	96	93	90	88	86	85
6.5	115	107	102	98	95	92	90	88	86
7.0	118	110	104	100	96	94	91	89	88
7.5	120	112	106	102	98	95	93	91	89
8.0	123	114	108	103	100	97	94	92	90
8.5	126	117	110	105	101	98	96	93	92
9.0	128	119	112	107	103	100	97	95	93
9.5	131	121	114	109	105	101	98	96	94
10.0	133	123	116	110	106	103	100	97	95
10.5	136	125	118	112	108	104	101	98	96
11.0		127	119	114	109	105	102	100	97
11.5		129	121	115	111	107	104	101	99
12.0		131	123	117	112	108	105	102	100
12.5		133	125	118	113	109	106	103	101
13.0		135	126	120	115	111	107	104	102
13.5			128	122	116	112	108	105	103
14.0			130	123	118	113	110	107	104
14.5			131	125	119	115	111	108	105
15.0			133	126	120	116	112	109	106
15.5			135	127	122	117	113	110	107
16.0				129	123	118	114	111	108

Example

300mm wide box gutter

Flow rate = 6.0 L/s

=> Adopt 100mm UPSTREAM depth

B2 - Selection of overflow device / DP combination

a) Dam Buster Rainheads

TABLE 1 – Dam Buster Rainhead

Downpipe size	Equivalent diameter	Mini RH	Standard Rainhead size ⁽¹⁾				
		MR-200	R-200	R-300	R-400	R-500	R-600
100 x 50	79	3.00	4.00 ⁽²⁾	5.00 ⁽³⁾			
80 diam.	80	3.00	4.00 ⁽²⁾	5.00 ⁽³⁾	Refer note (iv)		
90 diam.	90	4.00	4.70	6.50			
100 x 75	97	4.50	5.00	7.30	8.00		
100 diam.	100	4.50	5.00	7.60	8.80	8.80	
100 x 100	112			8.80	12.0	12.0	
125 diam.	125			9.50	14.2	15.4	15.9
150 x 100	137	Refer note (v)			15.8	16.0	16.0
150 diam.	150				16.0	16.0	16.0
Overflow Capacity of Device (L/s)		>12.0	>16.0	>16.0	>16.0	>16.0	>16.0
NOTES on rainhead capacities. (1) Curved fronted rainheads CR-www have the same capacity as rectangular rainheads (2) Capacities determined by testing by the AHSCA Research Foundation (3) Capacities determined based on testing of the R-200 rainhead and hydraulic analysis. (4) 'Stretched' and 'Widened' versions of rainheads are available in the 200 and 300 series. Calculations remain based on Table 1.							

Maximum permissible flow rates (litres / sec)

GENERAL NOTES

- (i) Values in black have been determined in accordance with AS/NZS 3500.3
- (ii) Values in red were determined by testing by the AHSCA Research Foundation
- (iii) Values in blue were also determined by testing by the AHSCA Research Foundation.
Note, AS/NZS 3500.3 permits the use of a 100x50 DP, however, no design charts are provided within the standard for this downpipe size, and consequently testing was required.
- (iv) For the R-400, R-500 & R-600, smaller downpipes than noted in the table may be used, provided the maximum permissible capacity is adopted as that for the next lowest rainhead size for which a value in the table is provided, for the same DP size. For example, for a 600 Rainhead, and 90 mm diam. DP, the maximum flow rate is 6.50 L/s.
- (v) These combinations are not possible
- (vi) Rectangular downpipes are considered to be 98% as effective as circular downpipes. Hence the equivalent diameter is based on 0.98 times the area of the rectangular downpipe.
- (vii) The capacities of **STRETCHED** and **WIDENED** rainheads are the same as for the standard versions (i.e. neither of these forms of the rainhead have additional capacity compared to the standard rainhead).
- (viii) **MINI** rainheads apply to the 200 series only. This rainhead has a reduced height only, including a reduced box gutter receiver depth of 150mm. These rainheads are suitable for small areas such as porticos and the flat back version is suitable for eaves gutters. They should not be used with Side Outlets due to the reduced box gutter receiver depth.

B2 - Selection of overflow device / DP combination (cont.)

a) Dam Buster Sumps

TABLE 2 – Dam Buster Sump

Normal downpipe size	Overflow Downpipe size	Sump Depth (mm)	Dam Buster Sump width (mm)				
			200	300	400	500	600
90 diam.	90 diam.	75					
" "	" "	100	3.00				
" "	" "	125		3.30			
" "	" "	150	3.60				
90 diam.	100 diam.	75		3.00			
" "	" "	100	3.40				
" "	" "	125		4.60			
" "	" "	150	5.05		5.05		
" "	" "	200		5.90	5.90		
100 diam.	100 diam.	75		3.40			
" "	" "	125		5.70			
" "	" "	150	6.25		6.25	6.25	6.25
" "	" "	200		7.30	7.30	7.30	7.30
150 diam.	150 diam.	150			12.2	12.2	12.2
" "	" "	200			16.0	16.0	16.0

Maximum permissible flow rates (litres / sec)

Notes

- There is one exception to values in the table above. When used in conjunction with a Side Outlet, the maximum flow rate in the 200 Dam Buster Sump should be limited to 5.0 L/s.
- denotes sump size not currently available as a standard size, or sump size and DP combination not permitted. Refer to available standard sizes in table below.
- denotes sump and DP size not recommended, however, the allowable flow rates provided in the same row may be used.
- Aerial overflow downpipes must be designed and installed at adequate grade to achieve the required flow rates. The minimum grades for critical flow rates specified in the design table (for PVC pipes) are provided in the table below for information purposes. These values have been determined from standard calculators based on the Colebrook-White equation. Note, these values apply to straight pipes with no additional bends than the bend below the sump. Where there are additional bends, obtain advice from a hydraulic engineer.

Pipe size	Flow rate	Min grade
90 diam	3.60	1 in 200
" " "	4.60	1 in 150
100 diam	5.50	1 in 200
" " "	7.30	1 in 120
150 diam	16.0	1 in 200

Refer also page 20 for an Aerial downpipe design chart.

- IMPORTANT** – AERIAL OVERFLOW PIPES MUST DISCHARGE VISIBLY TO ATMOSPHERE IN ORDER TO ALERT THE BUILDING MANAGER / BUILDING OWNER / BUILDING OCCUPANT THERE IS A BLOCKAGE IN THE SYSTEM.

Dam Buster sump standard sizes					
Width Depth	200 mm	300 mm	400 mm	500 mm	600 mm
75 mm		300-75			
100 mm	200-100				
125 mm		300-125			
150 mm	200-150		400-150	500-150	600-150
200 mm		300-200	400-200	500-200	600-200

B2 - Selection of overflow device / DP combination (cont.)

c) Dam Buster Side Outlets

Apart from one exception, as noted below, no design / sizing is required for the Side Outlet itself. The Side Outlet is automatically designed when the rainhead or sump is designed. Note that Side Outlets are supplied in two interlocking, sliding components, and are adjustable to any (larger) box gutter width within the specified range for the Side Outlet. For example, a 300mm Side Outlet can be fitted to any box gutter width in the range 300mm to 450mm. Refer to the Product Technical Statement for allowable widths and limitations etc.

Exception

For the 200 Side Outlet and Sump combination (only), the flow rate must be limited to 5.0 L/s (the maximum allowable design flow rate is the lessor of the value in the Sump design table and 5.0 L/s).

C1 - Design of Box Gutters & Upstream Devices - Elbows

(i) Dam Buster Elbows

Dam Buster Elbows are designed for the total flow rate in the upstream and downstream box gutters. Refer notes below for the detailed design procedure.

Device Size	Maximum Flow Rate (L/s)	Contraction Range for Upstream Gutter	Maximum box gutter depth at Entry (mm)	Drop within Elbow (mm)	Maximum box gutter depth at Exit (mm)
ELB-200	5.0	200	180	50	230
ELB-300	9.5	300 -> 200	215	60	265
ELB-400	16.0	400 -> 300	230	70	300
ELB-500	16.0	500 -> 300	230	70	300
ELB-600	16.0	600 -> 400	230	70	300

NOTES

1. The maximum box gutter depth at Entry to the device is the maximum allowable downstream depth of the upstream box gutter.
2. The Elbow is trimmed to match the designed downstream depth of the upstream box gutter. Refer to the Installation Manual.
3. The upstream box gutter is designed (in accordance with figure H.1 of AS/NZS 3500.3) for a flow rate equivalent to the total catchment area of the upstream and downstream box gutters. It is not necessary to design the downstream box gutter.
4. All Elbows are supplied as 'Sliding' Elbows (i.e. supplied in two-piece / adjustable) by default. Sliding Elbows are able to contract for the upstream box gutter width within the specified range (all sizes except 200)
5. 'Fixed' Elbows are also for special larger volume orders (over 20 units), however fixed Elbows are not adjustable for the upstream box gutter.
6. **ONLY THE UPSTREAM BOX GUTTER MAY BE CONTRACTED. THE DOWNSTREAM BOX GUTTER MAY NOT BE NARROWER THAN THE UPSTREAM BOX GUTTER.**

C1 - Design of Box Gutters & Upstream Devices - Junctions

(ii) Dam Buster Junctions

Dam Buster Junctions are also designed for the total flow in the upstream and downstream box gutters. Refer notes below for the detailed design procedure.

Device Size	Maximum Design Flow Rate (L/s)	Contraction Range for Upstream Gutter	Maximum box gutter depth at Entry (mm)	Drop within Junction (mm)	Maximum box gutter depth at Exit (mm)
TJN-200*	5.0	200	180	50	230
TJN-300**	9.5	300 -> 200	215	60	275
TJN-400***	16.0	400 -> 300	230	70	300
* Also CJN-200-L/R ** Also CJN-300-L/R *** Also CJN-400-L/R					

NOTES

1. The maximum box gutter depth at Entry to the device is the maximum allowable downstream depth of the 'critical upstream box gutter' (refer note 3).
2. The Junction is trimmed to match the design downstream depth of the 'critical upstream box gutter'. Refer to the Installation Manual.
3. The upstream box gutter with the larger catchment area (the 'critical upstream box gutter') only is designed, and the opposite upstream box gutter ('non-critical box gutter') is sized to match the 'critical box gutter'. It is not necessary to design the downstream box gutter.
4. The 'critical box gutter' is designed (in accordance with figure H.1 of AS/NZS 3500.3) for the the catchment area to this gutter, plus any additional catchment area flowing directly into the downstream box gutter.
5. The total flow rate in all gutters must not exceed the Maximum Design Flow rate in the table.
6. All Junctions are supplied as 'Sliding' Junctions (i.e. supplied in two-piece / adjustable) by default. Sliding Junctions are able to contract for the upstream box gutter width within the specified range (all sizes except 200)
7. 'Fixed' Junctions are also available for special larger volume orders (over 20 units), however Fixed Junctions are not adjustable for the upstream box gutter.
8. **ONLY THE UPSTREAM BOX GUTTERS MAY BE CONTRACTED. THE DOWNSTREAM BOX GUTTER MAY NOT BE NARROWER THAN THE UPSTREAMS BOX GUTTER.**

Design strategy for volume builder homes

Rainfall Category 'RC'	1%AEP Box gutters	5% AEP Eaves gutters	Box gutter factor, Kb	Eaves gutter factor, Ke
RC1	200mm /h	150mm /h	18	24
RC2	250mm /h	185 mm/h	14.4	19.5
RC3	300mm /h	225mm/h	12	16
RC4	350mm /h	260mm/h	10.3	13.8

NOTES

1. The 5% AEP is assumed to be 75% of the 1%AEP. This will cover most cases; however, this should be confirmed for each new suburb.
2. Refer to page 17 for an explanation of the Kb & Ke factors.
3. For homes with relatively small catchment areas, selection of the highest category for all proposed home locations (suburbs) may result in one roof drainage design only. For larger roof catchment areas, roof drainage designs for two rainfall categories only would typically be adequate, depending on the range of suburbs / locations proposed for that house.

Step A – Determine the rainfall intensity category for the property

- Determine the **Rainfall Category** for the suburb the house is being constructed in. This information would be determined once for each suburb using Methods 1 and / or 2 (see pages 4 and 5 for Methods 1 and 2).

Step B – Design the box gutters

- Determine the catchment area, 'CA', for each box gutter under consideration.
- Calculate the design flow rate 'Q', in L/s= CA / Kb, for example:
 - RC3, CA= 120m² => Q= 120/12 = 10 L/s
- Use the Dam Buster box gutter design charts to determine the minimum upstream depth for the selected fall for example:
 - 300mm wide box gutter, Q= 10 L/s, 1 in 150=> Upstream depth = 135mm
- Calculate the required downstream depth using the selected fall of the box gutter.
- Note - where there are 2 or more inlet box gutters, increase box gutter depths as required so that they are the same at their downstream ends i.e., at the entry to the overflow device

Step C – Design the box gutter overflow devices & upstream devices

- For **box gutter overflow devices**, select the overflow device and DP combination based on the total flow rate for from all 'inlet' box gutters
 - For Rainheads, and Side Outlet & Rainhead combinations
 - Use the Rainhead Design Table to select the device and DP combination
 - For Sumps
 - Use the Sump Design Table to select the device and DP combination
- For **Upstream devices**
 - Elbows
 - Use the box gutter design charts to select the upstream depth of the inlet box gutter, based on the total flow rate to the inlet and outlet gutters
 - Junctions
 - Use the box gutter design charts to select the upstream depth of the larger inlet box gutter, based on the total flow rate to the larger inlet box gutter, plus the outlet box gutter
 - Determine the downstream depth of the larger inlet box gutter using the fall
 - Set the downstream depth of the smaller inlet box gutter to be equal to the downstream depth of the larger box gutter

Design strategy for volume builder homes (cont.)

Explanation of Kb and Ke factors

In the design flow rate, 'Q', is calculated as follows (refer also Step 2, pages 6 and 7):

$$Q = \frac{\text{Catchment area ('CA')} \times \text{AEP}}{3600}, \text{ where-}$$

Q = Flow rate in L/s

CA= Catchment are in m²

AEP = Design rainfall intensity in mm/h

If 1 mm of rain falls on 1 m² of roof, that equates to 1 Litre of rainfall.

However, the rainfall intensity is provided in mm/h i.e. mm/3600 seconds. Hence, if we calculate the flow rate based on the AEP, we would get a result in mm/h. So we need to divide by 3600 to convert from mm/hour to mm/second.

The equate above can be re-written as:

$$Q = \frac{\text{Catchment area ('CA')}}{(3600 / \text{AEP})}$$

To simply this, the equation can be rewritten as-

$$Q = \frac{CA}{K} \text{ where } K = 3600/\text{AEP}$$

However, the values of k are different for box gutters (which are designed based on the 1% AEP) and eaves gutters (which are designed based on the 5% AEP).

Hence the K factors for box gutter and eaves gutters are determined as follows:

Box Gutters

$$K_b = 3600 / 1\% \text{ AEP}$$

Eaves Gutters

$$K_e = 3600 / 5\% \text{ AEP}$$

Refer to AS/NZS 3500.3-2021 for the design method for eaves gutters.



Design chart for aerial downpipes

Slope	Pipe diameter			
	90mm	100mm	150mm	225mm
1 in 200	4.14	5.49	16.2	47.5
1 in 190	4.26	5.65	16.6	48.9
1 in 180	4.39	5.82	17.1	50.3
1 in 170	4.53	6.00	17.7	51.9
1 in 160	4.68	6.21	18.3	53.7
1 in 150	4.85	6.43	18.9	55.6
1 in 140	5.04	6.68	19.6	57.7
1 in 130	5.25	6.96	20.5	60.1
1 in 120	5.49	7.27	21.4	62.7
1 in 110	5.76	7.63	22.4	65.7
1 in 100	6.07	8.04	23.6	69.2
1 in 90	6.43	8.52	25.0	73.3
1 in 80	6.86	9.09	26.7	78.0
1 in 70	7.38	9.77	28.7	83.9
1 in 60	8.03	10.6	31.2	91.1
1 in 50	8.87	11.7	34.4	100.4


Maximum flow rates* (L/s)

*** Based on a standard Colebrook-White calculator**

Note

The table assumes there are no additional bends in the aerial downpipe other than the bend below the sump. Where there are additional bends, which will result in energy losses, advice should be obtained from a hydraulic engineer.

Design Example - T Side Outlet & Rainhead combination

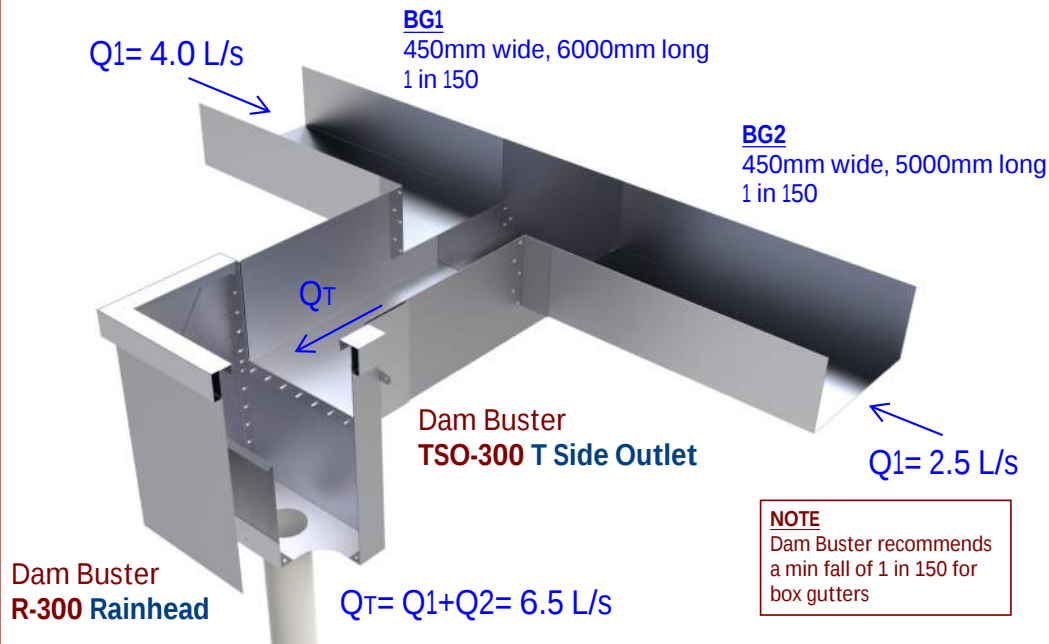

1 - Design the box gutters

From design charts, minimum upstream depths

BG1 - 91mm, adopt 95mm

BG2 - 86mm, adopt 90mm

Minimum downstream depths

BG1 = 95 + 6000/150 = 95 + 40 = 135

BG2 = 90 + 5000/150 = 90 + 35 = 125

Adopt

BG1 - (100mm to 140mm) Deep x 450mm wide

BG2 - " " " "

Note - 140mm is the standard height of a 300mm Side Outlet

2 - Select the overflow device and DP

The only design required is for the rainhead, as the Side Outlet is automatically designed

Adopt

Dam Buster **TSO-300 T Side Outlet** &
R-300 Rainhead combination
with 90mm Diam. DP

Note

All box gutters are designed for a minimum flow rate, $Q_{min} \approx 3.0$ L/s

TABLE 1 – Dam Buster Rainhead

Downpipe size	Equivalent diameter	Dam Buster Rainhead size ⁽¹⁾				
		R-200	R-300	R-400	R-500	R-600
100 x 50	79	4.00 ⁽²⁾	5.00 ⁽³⁾			
80 diam.	80	4.00 ⁽²⁾	5.00 ⁽³⁾		Refer note (iv)	
90 diam.	90	4.70	6.50			
100 x 75	97	5.00	7.30	8.00		
100 diam.	100	5.00	7.60	8.80	8.80	
100 x 100	112		8.80	12.0	12.0	
125 diam.	125		9.50	14.2	15.4	15.9
150 x 100	137	Refer note (v)		15.8	16.0	16.0
150 diam.	150			16.0	16.0	16.0
Overflow Capacity of Device (L/s)		>16.0	>16.0	>16.0	>16.0	>16.0

(1) Curved fronted rainheads CR-www have the same capacity as rectangular rainheads

(2) Capacities determined by testing by the AHSCA Research Foundation

(3) Capacities determined based on testing of the R-200 rainhead and hydraulic analysis.

(4) 'Stretched' and 'Widened' versions of rainheads are available in the 200 and 300 ranges. Calculations remain based on Table 1.

Maximum permissible flow rates (litres / sec)

Design Example - Dam Buster (Free Flow) Sump

90mm Diam. Full Blockage
Overflow Indicator

BG1

400mm wide, 8000mm long
1 in 150

Dam Buster
SU-400-200 Sump

$Q = 6.5 \text{ L/s}$

NOTE

Dam Buster recommends
a min fall of 1 in 150 for
box gutters

1 - Design the box gutter

From design charts, minimum upstream depth:

BG1 - 106mm say 110mm

Downstream depth

$BG1 = 110 + 8000/150 = 110 + 55 = 165\text{mm}$ say 170mm

Adopt

BG1 - (110mm to 170mm) deep x 400mm wide

2 - Select the overflow device and DP

Adopt

Dam Buster **SU-400-200 Sump** with
100mm Primary DP &

100mm Aerial Overflow DP, 1 in 140* min

* Refer design chart for aerial overflow
pipes, page 20

TABLE 2 – Dam Buster Sump

Normal downpipe size	Overflow Downpipe size	Sump Depth (mm)	Dam Buster Sump width (mm)				
			200	300	400	500	600
90 diam.	90 diam.	75					
" "	" "	100	3.00				
" "	" "	125		3.30			
" "	" "	150	3.60				
90 diam.	100 diam.	75		3.00			
" "	" "	100	3.40				
" "	" "	125		4.60			
" "	" "	150	5.05		5.05		
" "	" "	200		5.90	5.90		
100 diam.	100 diam.	75		3.40			
" "	" "	125		5.70			
" "	" "	150	6.25		6.25	6.25	6.25
" "	" "	200		7.30	7.30	7.30	7.30
150 diam.	150 diam.	150			12.2	12.2	12.2
" "	" "	200			16.0	16.0	16.0

Maximum permissible flow rates (litres / sec)

Dam Buster sump standard sizes

Width Depth	200 mm	300 mm	400 mm	500 mm	600 mm
75 mm		300-75			
100 mm	200-100				
125 mm		300-125			
150 mm	200-150		400-150	500-150	600-150
200 mm		300-200	400-200	500-200	600-200

Design example including upstream devices

The example below includes one 'upstream' device, a Dam Buster Elbow. Careful coordination is required between all box gutter depths. In this case, the maximum box gutter depth was determined by commencing at the upstream end of BG1 and then working towards the downstream end BG1a. The upstream depth of BG1b was then set by working upstream after matching the downstream depth of BG1b with the downstream depth of BG1a. Then the downstream depth of BG2 was calculated and finally upstream depth BG2a was determined. Designs are unlikely to be more complicated than this one and it should be noted that determining a compliant solution using the DtS devices in AS/NZS 3500.3, whilst fitting within the architectural constraints, would not have been possible. Note, it is recommended box gutter numbers, and upstream device numbers match the numbering for the overflow device. For example, BG2, BG2a, BG2b & ELB2 all contain the number '2' to match the overflow device numbers S02 & S2.

BG1, BG1a, S01 & RH1

Box gutters

BG1 - 300mm wide x (105 mm MIN to 150mm MAX) deep box gutter

BG1a - 300mm wide x (105 mm MIN to 150mm MAX) deep box gutter

Overflow device

S01 & RH1 - Dam Buster **CSO-300-L Corner Side Outlet** &
Dam Buster **R-300 Rainhead** with 90mm Diam. DP

BG3 & S3

Box gutter

200mm wide x (105 mm MIN to 150mm MAX) deep box gutter

Overflow device

S3 - Dam Buster **SU-200-100 Sump** with 90mm DIAM Primary DP & 100mm DIAM overflow DP to discharge visibly to atmosphere through north wall at low level. Provide full blockage overflow indicator (refer typical sump details, drawing RD08).

NOTE - Top of sump must be left open for maintenance purposes.
Roof plumber to provide flashings as required.

BG2, BG1a, BG2b, EL2, S02 & S2

Box gutters

BG2 - 300mm wide x (170mm MIN to 185mm MAX) deep box gutter

BG2a - 300mm wide x (160mm MIN to 185mm MAX) deep box gutter


BG2b - 300mm wide x (90mm MIN to 100mm MAX) deep box gutter

Change of direction device

ELB2 - Dam Buster **ELB-300-L Elbow**

Overflow device

S02 & S2 - Dam Buster **CSO-300-L Corner Side Outlet** &
Dam Buster **SU-300-75 Sump** with 90mm Primary DP & 100mm DIAM overflow DP, to discharge visibly to atmosphere through fibre cement sheet soffit of canopy.

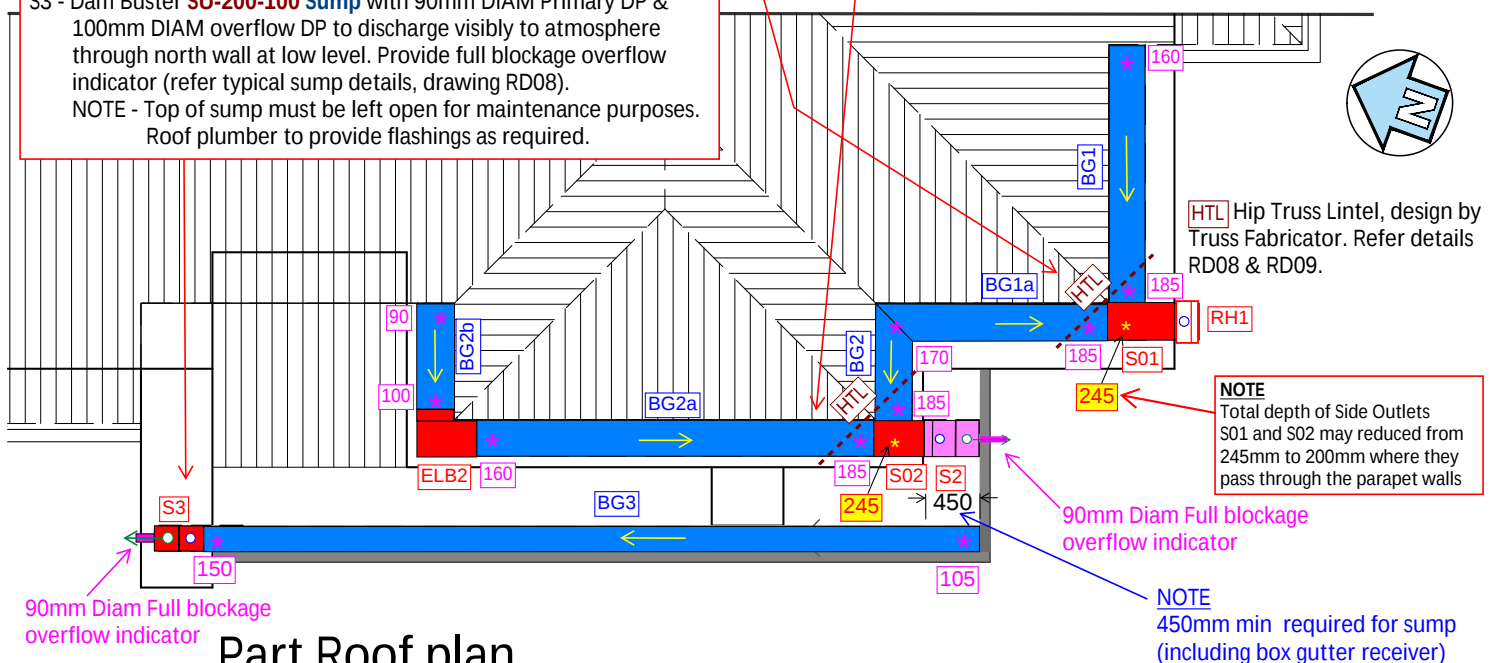

Part Roof plan

1:50 @ A3

Maintenance & cleaning

Refer to note on drawing RD10

xxx Box gutter spot depths

xxx Total depth within Side Outlet

DP1 90 mm Primary DIAM. DP

DP2 100 mm Overflow DIAM. DP

Dam Buster products required

2 x **R-300 Rainheads**

2 x **CSO-300-L Corner Side Outlets**

1 x **ELB-300-L Elbow**

1 x **SU-300-75 Sump**

1 x **SU-200-100 Sump**


Notes

1. Substitutions are not permitted.
2. Contractor to check list of products is consistent with plans

NOTE - SAFE ROOF ACCESS

PHE recommends safe access be provided to all roofs to enable regular maintenance / cleaning of gutters to be carried out. Refer also to note on drawing RD11.

All flashings and cappings to comply with SA HB39-2015 and AS/NZS 3500.3-2021




Dam Buster Product Names




Label	Name		Sizes				
Rainheads							
R- <i>www</i>	Rainhead		R-200	R-300	R-400	R-500	R-600
CR- <i>www</i>	Curved Rainhead		CR-200	CR-300	CR-400	CR-500	CR-600
R- <i>www</i> -FB	Flat Back Rainhead		R-200-FB	R-300-FB	R-400-FB	R-500-FB	R-600-FB
CR- <i>www</i> -FB	Flat Back Curved Rainhead		CR-200-FB	CR-300-FB	CR-400-FB	CR-500-FB	CR-600-FB
Stretched Rainheads							
R-200- <i>www</i>	Stretched R-200 Rainhead ⁽¹⁾		R-200-300	n/a			
R-200- <i>www</i> -FB	Stretched Flat Back R-200 Rainhead ⁽¹⁾		R-200-300-FB	n/a			
R-300- <i>www</i>	Stretched R-300 Rainhead ⁽¹⁾		n/a	R-300-350 R-300-380	R-300-400 R-300-450	R-300-500	R-300-600
R-300- <i>www</i> -FB	Stretched Flat Back R-300 Rainhead ⁽¹⁾		n/a	R-300-350-FB R-300-380-FB	R-300-400-FB R-300-450-FB	R-300-500-FB	R-300-600-FB
Widened Rainheads							
WR- <i>www</i>	Widened Rectangular Rainhead ⁽²⁾		WR-200	WR-300	n/a	n/a	n/a
Maxi Rainheads							
R- <i>www</i> -MX	Maxi Rainhead ⁽³⁾		n/a	R-300-MX	n/a		
CR- <i>www</i> -MX	Maxi Curved Rainhead ⁽³⁾		n/a	CR-300-MX	n/a		
R- <i>www</i> -MX-FB	Maxi Flat Back Maxi Rainhead ⁽³⁾		n/a	R-300-MX-FB	n/a		
CR- <i>www</i> -MX-FB	Maxi Curved Flat Back Rainhead ⁽³⁾		n/a	CR-300-MX-FB	n/a		
Mini Rainheads							
MR- <i>www</i>	Mini Rainhead ⁽⁴⁾		MR-200	n/a			
MCR- <i>www</i>	Mini Curved Rainhead ⁽⁴⁾		MCR-200	n/a			
MR- <i>www</i> -FB	Mini Flat Back Rainhead ⁽⁴⁾		MR-200-FB	n/a			
MCR- <i>www</i> -FB	Mini Curved Flat Back Rainhead ⁽⁴⁾		MCR-200-FB	n/a			
Sumps							
SU- <i>www</i> -ddd	Sump	Width Depth	200	300	400	500	600
		75		SU-300-75			
		100	SU-200-100				
		125		SU-300-125			
		150	SU-200-150		SU-400-150	SU-500-150	SU-600-150
		200		SU-300-200	SU-400-200	SU-500-200	SU-600-200
Side Outlets							
TSO- <i>www</i>	T Side Outlet		TSO-200	TSO-300	TSO-400	Expansion ranges 200 series – 200mm to 350mm 300 series – 300mm to 450mm 400 series – 400mm to 600mm Note - For the CSO and XSO, only the box gutters parallel to the parapet wall are expandable.	
ESO- <i>www</i> -L	End Side Outlet, LH		ESO-200-L	ESO-300-L	ESO-400-L		
ESO- <i>www</i> -R	End Side Outlet, RH		ESO-200-R	ESO-300-R	ESO-400-R		
CSO- <i>www</i> -L	Corner Side Outlet, LH		CSO-200-L	CSO-300-L	CSO-400-L		
CSO- <i>www</i> -R	Corner Side Outlet, RH		CSO-200-R	CSO-300-R	CSO-400-R		
XSO- <i>www</i>	Cruciform Side Outlet		XSO-200	XSO-300	XSO-400		
Elbows							
ELB- <i>www</i> -L	Elbow, LH		ELB-200-L	ELB-300-L	ELB-400-L	ELB-500-L	ELB-600-L
ELB- <i>www</i> -R	Elbow, RH		ELB-200-R	ELB-300-R	ELB-400-R	ELB-500-R	ELB-600-R
Junctions						Contraction ranges for Elbows and Junctions Refer to the Standard drawing details for contraction ranges	
TJN- <i>www</i>	T Junction		TJN-200	TJN-300	TJN-400		
CJN- <i>www</i> -L	Corner Junction, LH		CJN-200-L	CJN-300-L	CJN-400-L		
CJN- <i>www</i> -R	Corner Junction, RH		CJN-200-R	CJN-300-R	CJN-400-R		
Ancillary Products							
BGA- <i>www</i> -WWW	Box Gutter Adaptor	Height = 200mm	BGA-200-300		n/a		
		Height = 250mm	n/a	BGA-300-600			
			n/a		BGA-400-600		
CL- <i>www</i>	Chute Lid		CL-200	CL-300	CL-400	CL-500	CL-600
SDC- <i>www</i>	Sump Deflector Cover		SDC-200	SDC-300	SDC-400	SDC-500	SDC-600
FKC- <i>www</i>	Flashing Kit - Chased flashing			FKC-365	FKC-465		FKC-665
FKP- <i>www</i>	Flashing Kit - Pressure flashing			FKP-365	FKP-465		FKP-665
JP-002	Joiner Plates (sold as a pair)		For the Continuous Sump and Back-to-Back Sumps (fits all series 200 to 600)				

NOTES

- Stretched** rainheads. Stretched rainheads (including the box gutter receiver, where applicable) are 'stretched' in the direction perpendicular to the box gutter. All other dimensions remain the same. For example, an R-300-**350** is simply an R-300 rainhead, which has been 'stretched' to accommodate a 350mm wide box gutter, rather than a 300mm wide box gutter.
- Widened** rainheads. Widened rainhead are standard rainheads, which have been widened in the direction perpendicular to the box gutter, apart from the box gutter receiver. For example, an WR-200 rainhead fits a 200mm wide box gutter, but has the same width as an R-300 rainhead. This product is suitable for situations where the penetration made in the wall is too large, and the rainhead needs to be widened to cover the penetration.
- Maxi** rainheads. These rainheads are lengthened (only) in the direction of the box gutter and have the same design flow rates as standard rainheads.
- Mini** rainheads. This applies to the 200 series only. This rainhead has a reduced height (and reduced maximum design flowrates).
- Flashing Kits** are supplied as either **Chased ('FKC')** walls flashings or **Pressure ('FKP')** wall flashings.
- All **Side Outlets** and Elbows are supplied as **'Sliding'** (i.e. two-piece / adjustable). However, these products can also be supplied as **'Fixed'** (i.e. one-piece) for special larger volume orders (over 20 units).

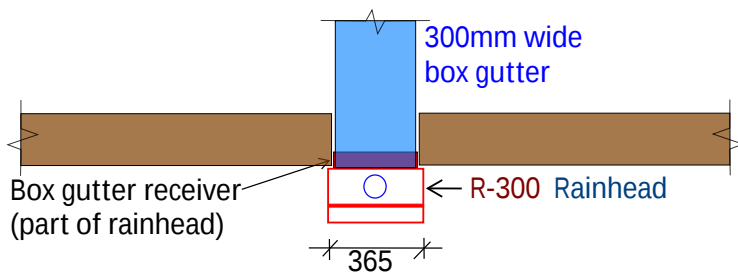


Standard Rainhead

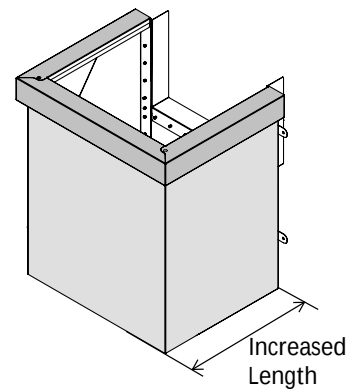


Maxi Rainhead

- 300 Series only
- Standard rainhead with **increased length**
- Designed as per standard rainhead
- Useful for upper floors where the upper external wall is set back slightly from the lower floor wall due to different cladding types eg brick veneer to lower floor and lightweight panels to upper floor.

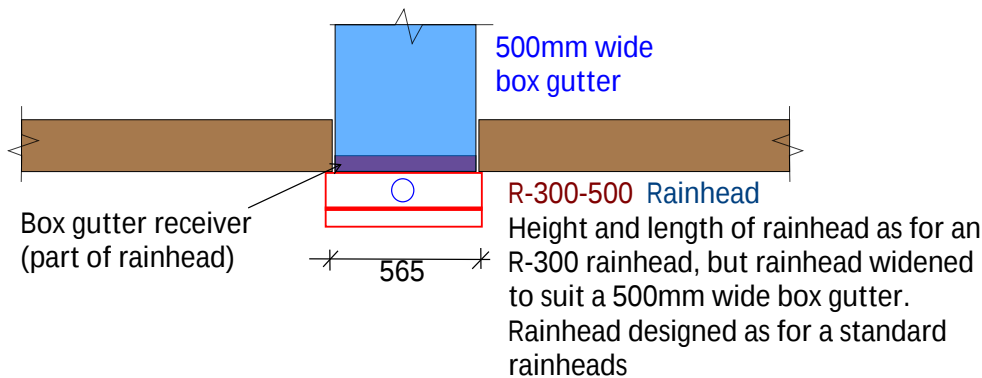


Stretched Rainhead

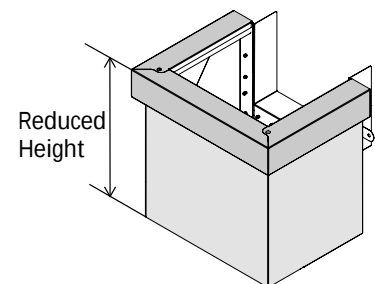


Mini Rainhead

- 200 Series only
- Standard rainhead with **reduced height**
- Reduced maximum flow rate
- Suits small roof areas eg porticos
- Flat back version suits eaves gutter
- Do **not** use with Side Outlets due to reduce depth of box gutter receiver of 150mm

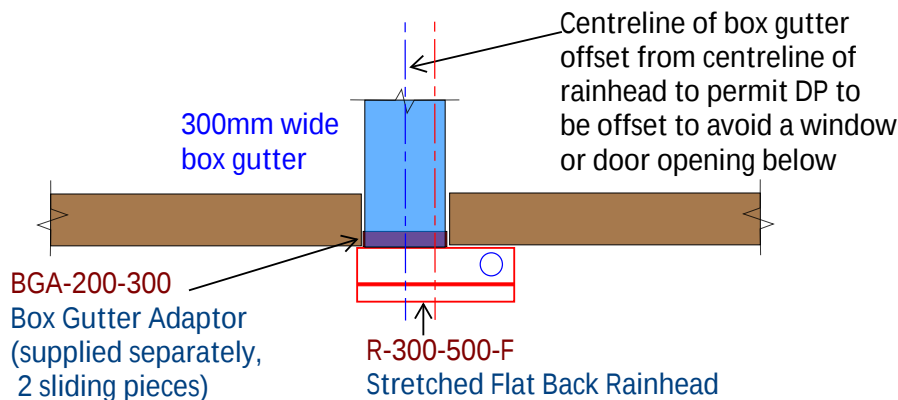

Stretched Flat Back Rainhead fitted with a Box Gutter Adaptor

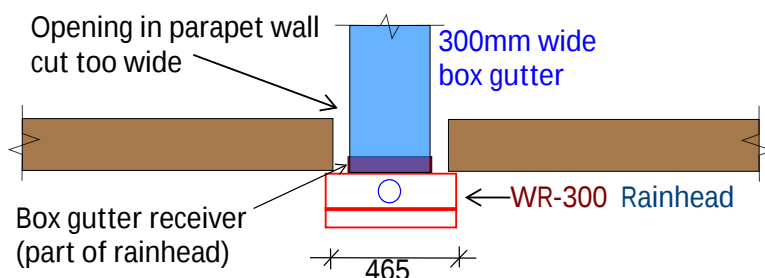

Widened Rainhead

NOTE
Sizes are examples only

Dam Buster Flashing Kits

Flashing kits are available for installations where the opening in the parapet wall has been made too large, requiring a wall flashing to be installed above the rainhead.

There are two types of flashing kits available, one for where the flashing is chased into the wall, and the other where a pressure flashing is used. There are 3 x sizes available for each Flashing Kit - refer to the Dam Buster Product Names table in this document for available sizes and refer to the Product Data sheets for full dimensions.

These flashings should be installed in accordance with section 8 of SA HB39-2015 Installation code for metal roof and wall cladding. Flashing kits can be adjusted / trimmed to suit the application.



FKC-www
Flashing Kit - Chased flashing



FKP-www
Flashing Kit - Pressure flashing

PERFORMANCE SOLUTION PROCESS & DOCUMENTATION

Required when the Regulatory Authority or Building Surveyor / Building Certifier does not accept Dam Buster products as being Deemed-to-Satisfy by Expert Judgement.

STEP A - Fill out the job details for the PBDB (Performance Based Design Brief) and have all 'key stakeholders' sign it.

Note - Refer to the Dam Buster website for a PBDB template.

STEP B - Document the proposed solution

STEP C - Prepare the Final Report and attach the signed PBDB.

Note - there is a Final Report template on the Dam Buster website for each of the following (which have similar, but different, Performance Requirements):-

- BCA Vol 1

- BCA Vol 2

- PCA (VIC)

- PCA (TAS)

The documentation (drawings / sketches and computations) must be attached to the Final report.


DAM BUSTER®

Product Data Sheet Rainhead R-www & R-www-F



Standard sizes to suit 200mm, 300mm, 400mm, 500mm and 600mm wide box gutters. Refer to the table below for available Non-Standard sizes.

-F refers to the **Flat Back** version of the rainhead (i.e no box gutter receiver)

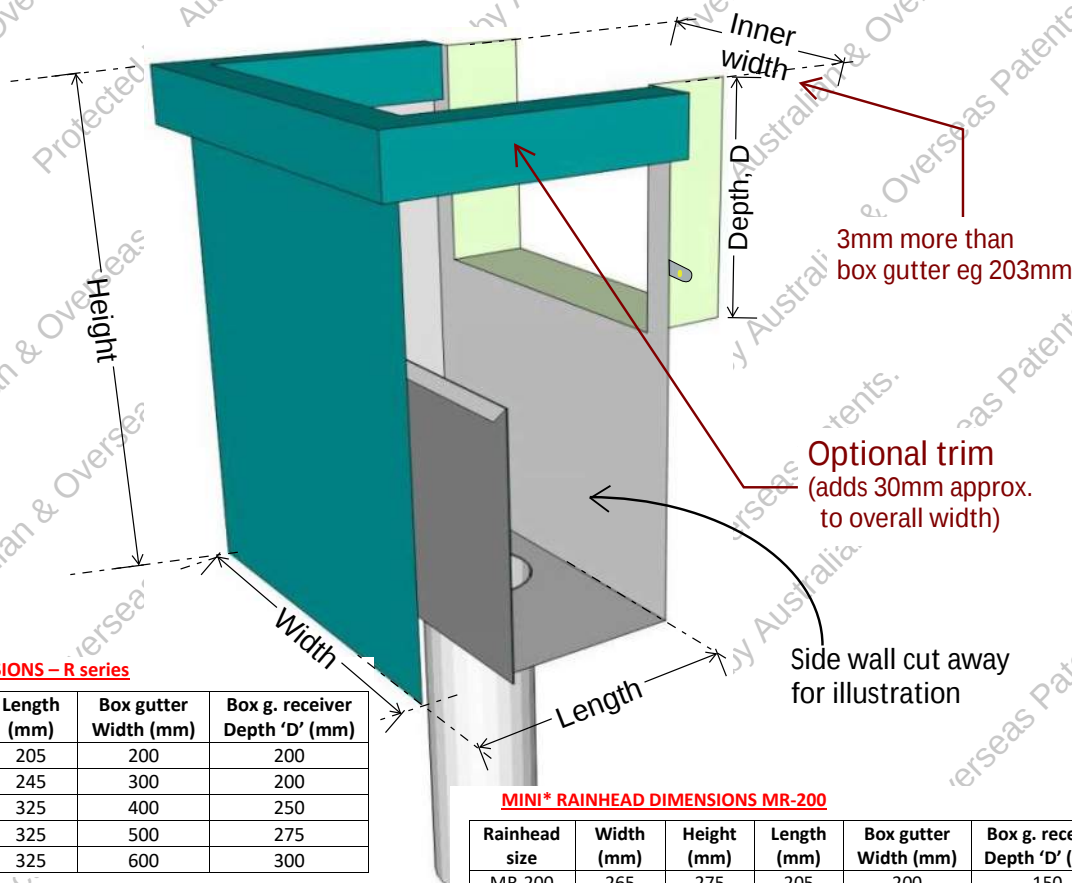

STANDARD RAINHEAD DIMENSIONS – R series

Rainhead size	Width (mm)	Height (mm)	Length (mm)	Box gutter Width (mm)	Box g. receiver Depth 'D' (mm)
R-200	265	350	205	200	200
R-300	365	450	245	300	200
R-400	465	600	325	400	250
R-500	565	650	325	500	275
R-600	665	700	325	600	300

WIDENED* RAINHEAD DIMENSIONS WR-200+ & WR-300+

Rainhead size	Width (mm)	Height (mm)	Length (mm)	Box gutter Width (mm)	Box g. receiver Depth 'D' (mm)
WR-200+	365	350	205	200	200
WR-300+	465	450	245	300	200

* The rainhead (excluding the box gutter receiver) is widened in the direction perpendicular to the box gutter.

MAXI* RAINHEAD DIMENSIONS R-300-MX

Rainhead size	Width (mm)	Height (mm)	Length (mm)	Box gutter Width (mm)	Box g. receiver Depth 'D' (mm)
R-300-MX	365	450	300	300	200

* The rainhead is lengthened (only) in the direction parallel to the box gutter.

MINI* RAINHEAD DIMENSIONS MR-200

Rainhead size	Width (mm)	Height (mm)	Length (mm)	Box gutter Width (mm)	Box g. receiver Depth 'D' (mm)
MR-200	265	275	205	200	150

* The rainhead height (including the box gutter receiver) is reduced

STRETCHED* RAINHEAD DIMENSIONS R-200-xxx & R-300-xxx series

Rainhead size	Width (mm)	Height (mm)	Length (mm)	Box gutter Width (mm)	Box g. receiver Depth 'D' (mm)
R-200-300	365	350	205	300	200
R-300-350	415	450	245	350	200
R-300-380	445	450	245	380	200
R-300-400	465	450	245	400	200
R-300-450	515	450	245	450	200
R-300-500	565	450	245	500	200
R-300-600	615	450	245	500	200

* The rainhead (including the box gutter receiver) is 'stretched' in the direction perpendicular to the box gutter.



CERTIFIED PRODUCT
(RECTANGULAR RAINHEAD
OVERFLOW PERFORMANCE)



HARDWARE AND BUILDING
PRODUCT DESIGN

GOOD
DESIGN
AWARD®
WINNER

DAM BUSTER
RAIN HEAD


DAM BUSTER®

Product Data Sheet Curved Rainhead CR-www & CR-www-F



Standard sizes to suit 200mm, 300mm, 400mm
500mm & 600mm wide box gutters.

-F refers to the **Flat Back**
version of the rainhead
(i.e no box gutter receiver)

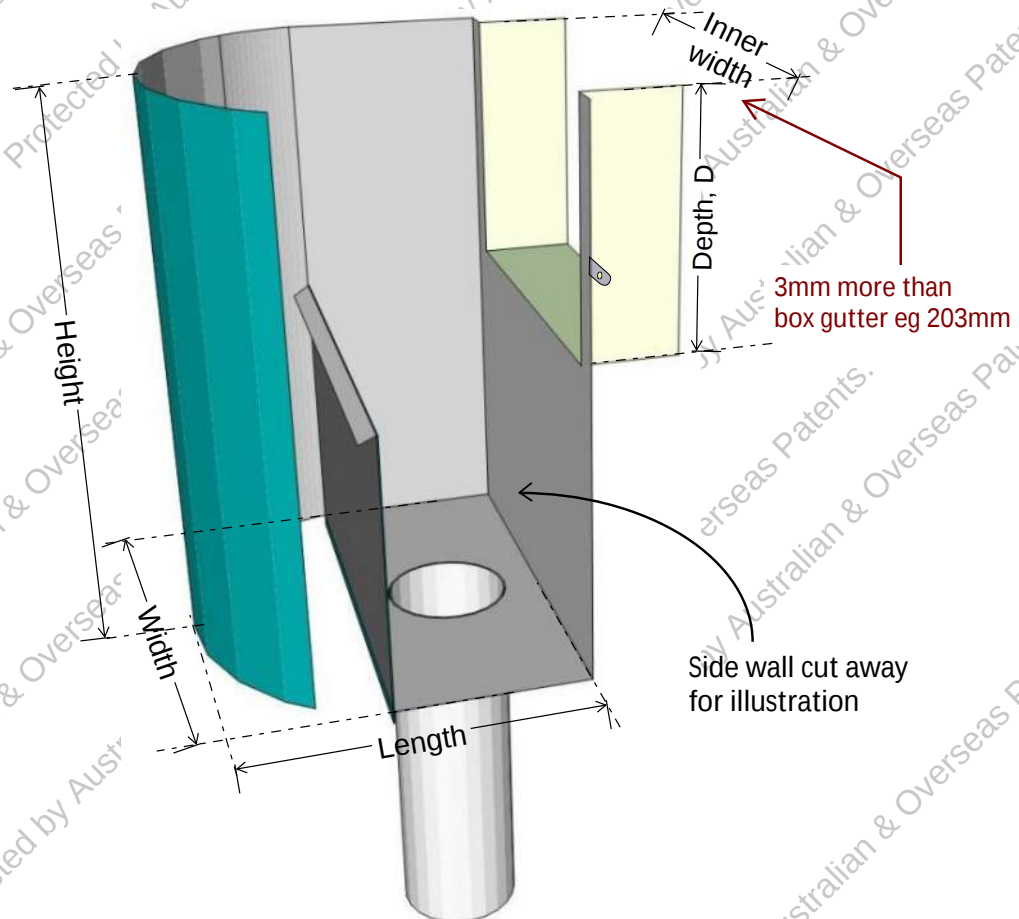

CURVED RAINHEAD DIMENSIONS – CR series

Rainhead size	Width (mm)	Height (mm)	Length (mm)	Box gutter Width (mm)	Box g. receiver Depth 'D' (mm)
CR-200	265	350	240	200	200
CR-300	365	450	290	300	200
CR-400	465	600	375	400	250
CR-500	565	650	375	500	275
CR-600	665	700	375	600	300

MAXI* CURVED RAINHEAD DIMENSIONS CR-300-MX

Rainhead size	Width (mm)	Height (mm)	Length (mm)	Box gutter Width (mm)	Box g. receiver Depth 'D' (mm)
CR-300-MX	365	450	345	300	200

* The rainhead is lengthened (only) in the direction parallel to the box gutter

MINI* CURVED RAINHEAD DIMENSIONS MCR-200


Rainhead size	Width (mm)	Height (mm)	Length (mm)	Box gutter Width (mm)	Box g. receiver Depth 'D' (mm)
MCR-200	265	275	240	200	150

* The rainhead height (including the box gutter receiver) is reduced



Product Data Sheet 'T' Side Outlets TSO-www

Standard sizes to suit any box gutter width between 200mm to 600mm.
Must only be used in combination with a Dam Buster Rainhead

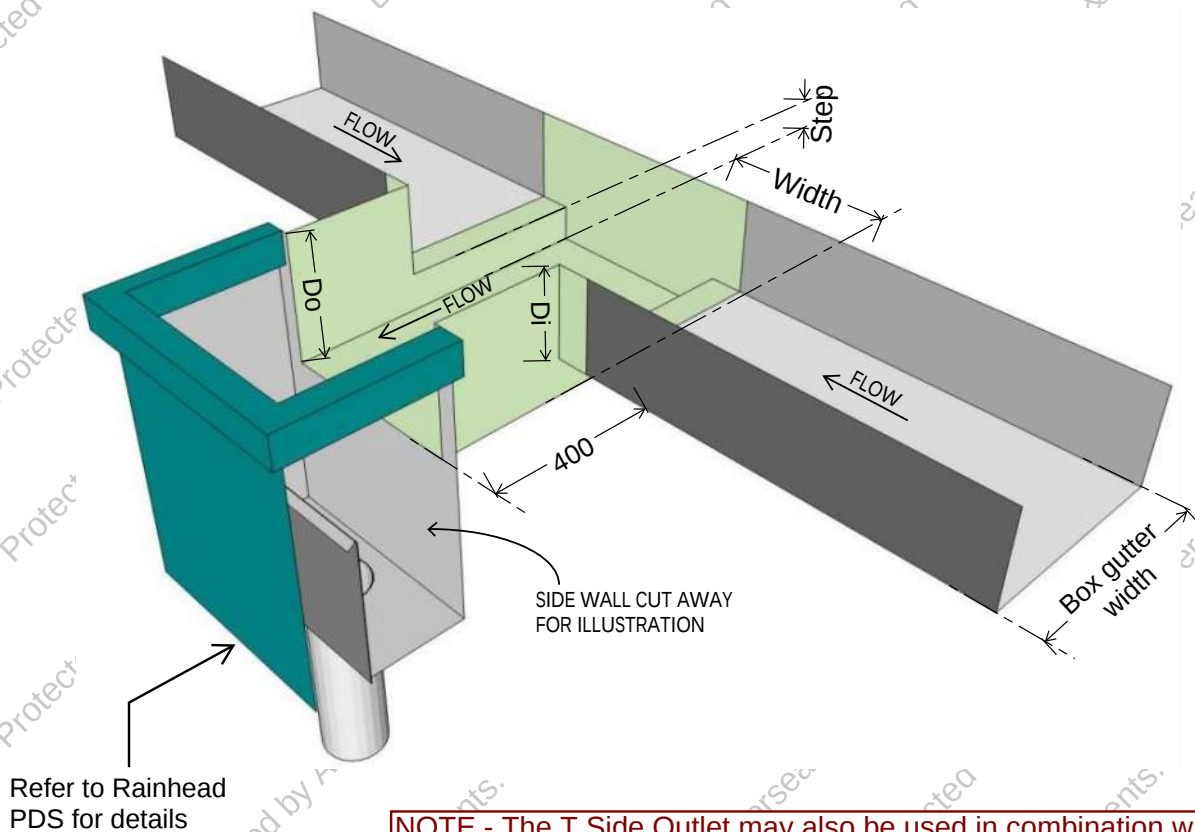

NOTE - The T Side Outlet may also be used in combination with a Dam Buster Sump - refer to the Standard Details drawings

'T' Side Outlet dimensions


Side Outlet size	Rainhead size	Width (mm)	Nominal Step (mm)	INLET Depth, Di (mm)	OUTLET Depth, Do (mm)	Box gutter width range (mm)
TSO-200	R-200 or CR-200	200	50	150	200	200 to 350
TSO-300	R-300 or CR-300	300	60	140	200	300 to 450
TSO-400	R-400 or CR-400	400	70	180	250	400 to 600



Product Data Sheet

'End' Side Outlets ESO-www-L

Standard sizes to suit any box gutter width between 200mm to 600mm.
Must only be used in combination with a Dam Buster Rainhead

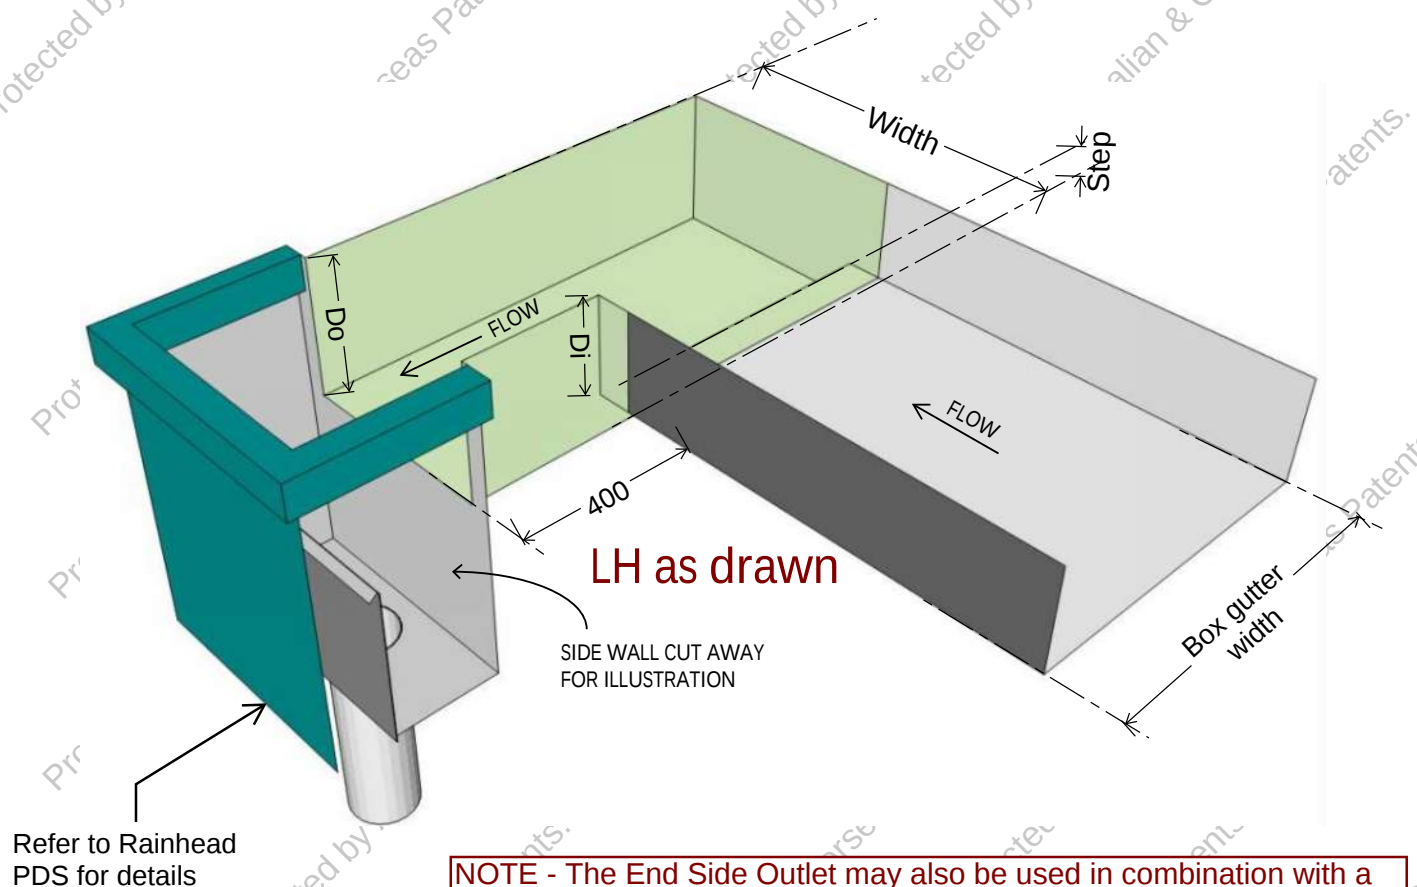

NOTE - The End Side Outlet may also be used in combination with a Dam Buster Sump - refer to the Standard Details drawings

'End' Side Outlet dimensions


Side Outlet size	Rainhead size	Width (mm)	Nominal Step (mm)	INLET Depth, Di (mm)	OUTLET Depth, Do (mm)	Box gutter width range (mm)
ESO-200-L	R-200 or CR-200	200	50	150	200	200 to 350
ESO-300-L	R-300 or CR-300	300	60	140	200	300 to 450
ESO-400-L	R-400 or CR-400	400	70	180	250	400 to 600



Product Data Sheet

'End' Side Outlets ESO-www-R

Standard sizes to suit any box gutter width between 200mm to 600mm.
Must only be used in combination with a Dam Buster Rainhead

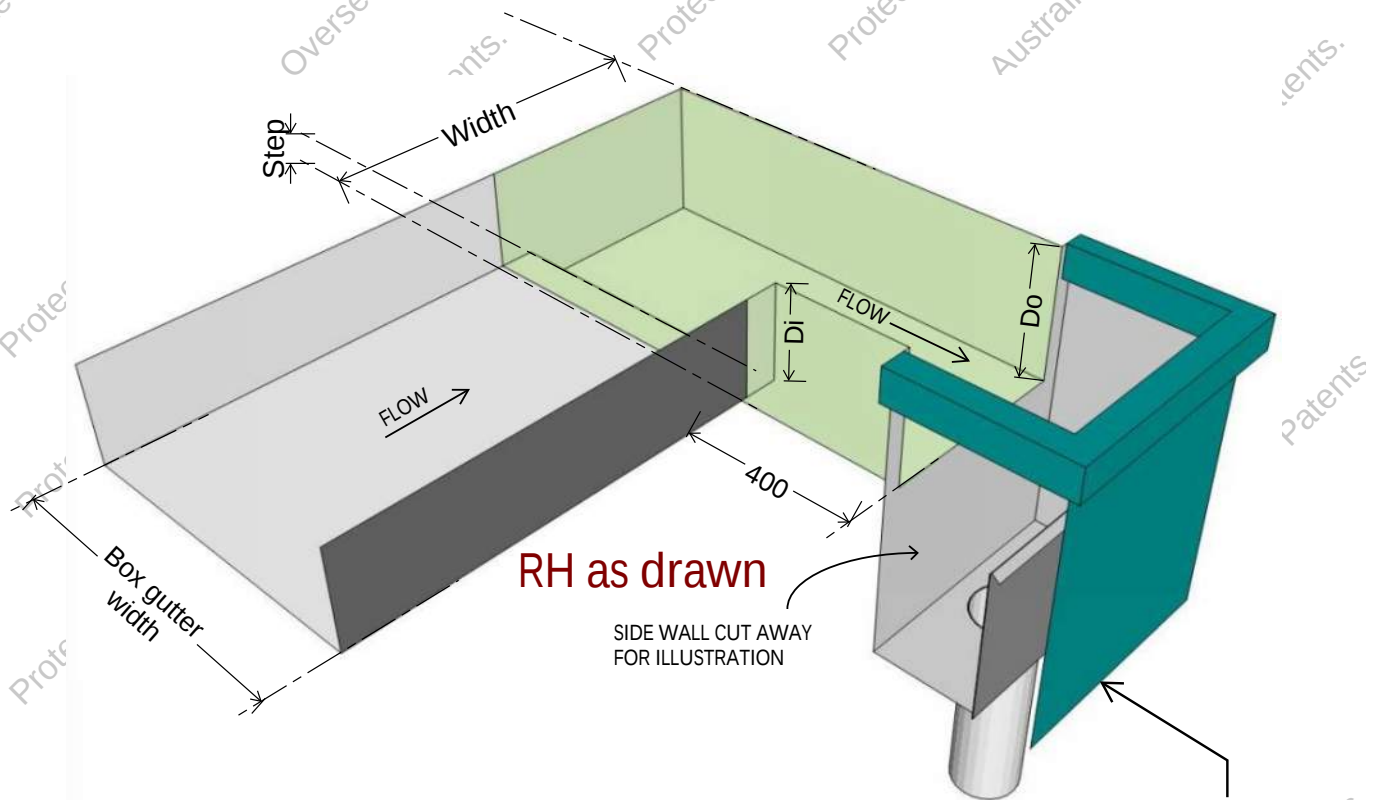

NOTE - The End Side Outlet may also be used in combination with a Dam Buster Sump - refer to the Standard Details drawings

Refer to Rainhead PDS for details


'End' Side Outlet dimensions

Side Outlet size	Rainhead size	Width (mm)	Nominal Step (mm)	INLET Depth, Di (mm)	OUTLET Depth, Do (mm)	Box gutter width range (mm)
ESO-200- R	R-200 or CR-200	200	50	150	200	200 to 350
ESO-300- R	R-300 or CR-300	300	60	140	200	300 to 450
ESO-400- R	R-400 or CR-400	400	70	180	250	400 to 600



Product Data Sheet 'Corner' Side Outlets CSO-www-L

Standard sizes to suit any box gutter width between 200mm to 600mm.
Must only be used in combination with a Dam Buster Rainhead

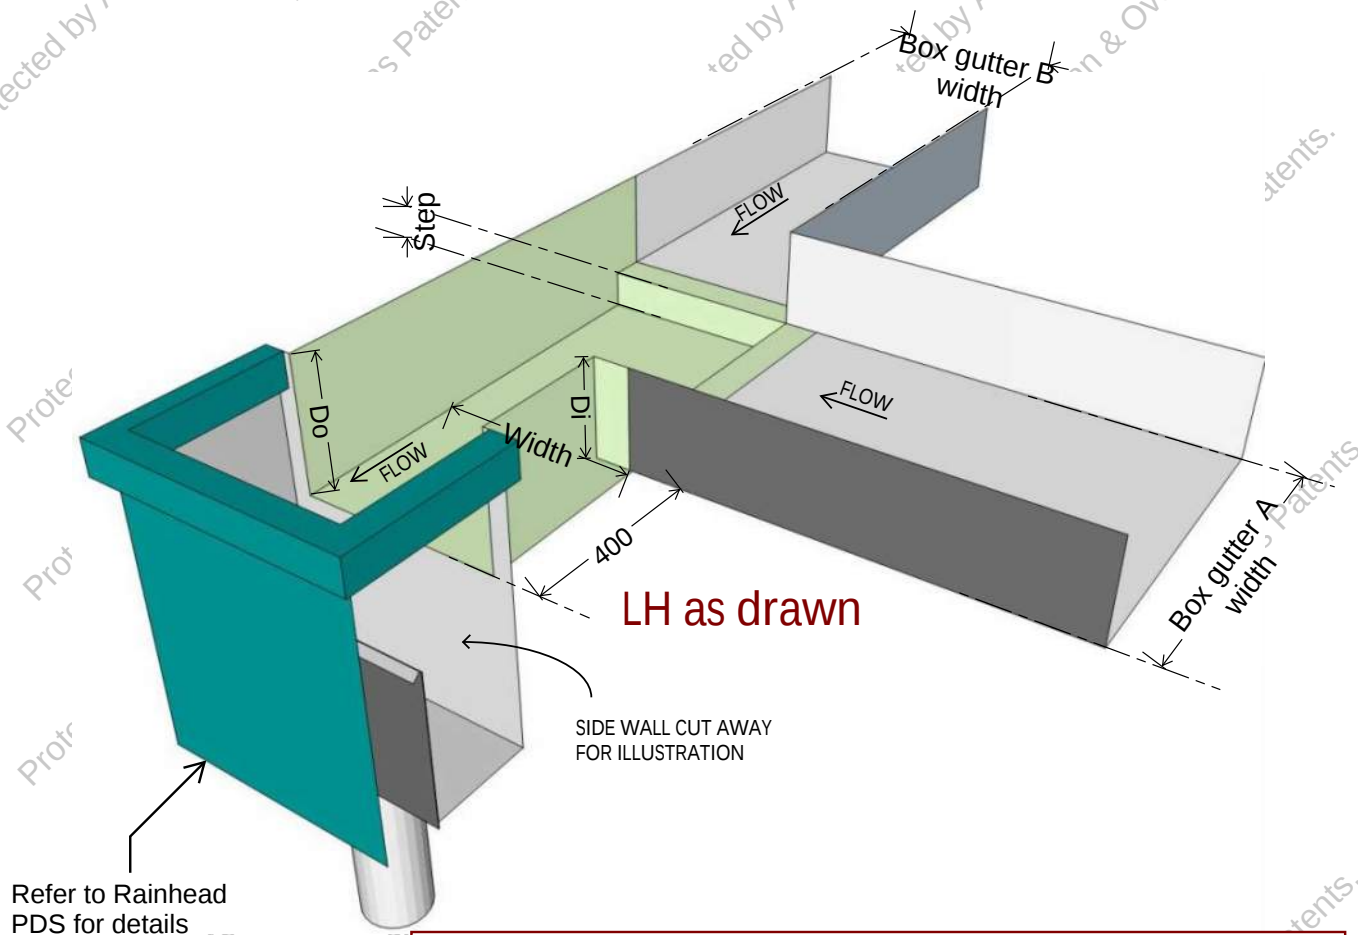

NOTE - The Corner Side Outlet may also be used in combination with a Dam Buster Sump - refer to the Standard Details drawings


'Corner' Side Outlet dimensions

Side Outlet Size	Rainhead size	Width (mm)	Nominal Step (mm)	INLET Depth, Di (mm)	OUTLET Depth, Do (mm)	Box gutter A width range (mm)	Box gutter B width (mm)
CSO-200-L	R-200 or CR-200	200	50	150	200	200 to 350	200
CSO-300-L	R-300 or CR-300	300	60	140	200	300 to 450	300
CSO-400-L	R-400 or CR-400	400	70	180	250	400 to 600	400



Product Data Sheet 'Corner' Side Outlets CSO-www-R

Standard sizes to suit any box gutter width between 200mm to 600mm.
Must only be used in combination with a Dam Buster Rainhead

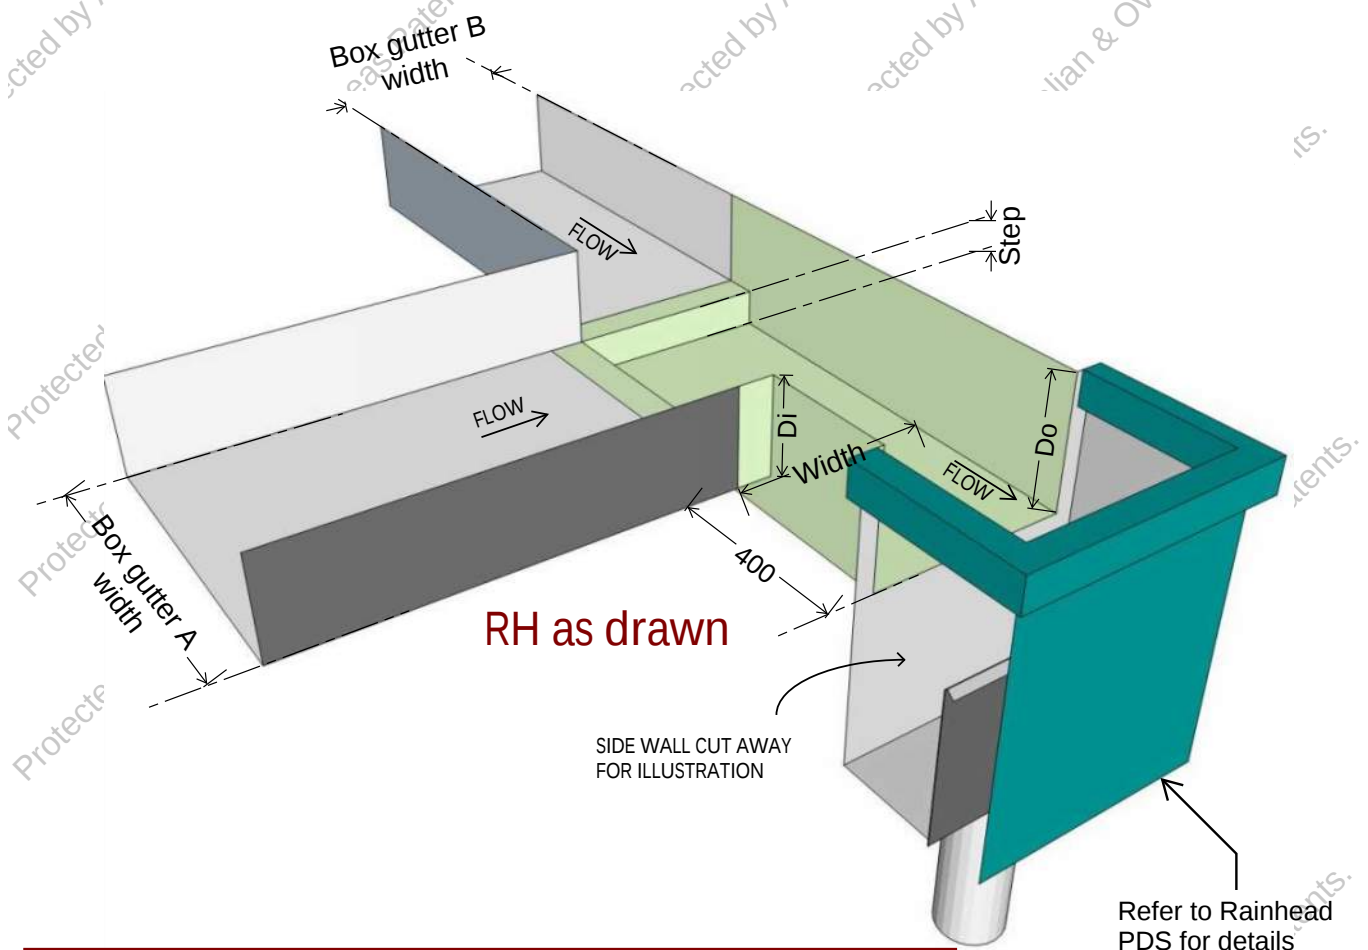

NOTE - The Corner Side Outlet may also be used in combination with a Dam Buster Sump - refer to the Standard Details drawings

'Corner' Side Outlet dimensions


Side Outlet Size	Rainhead size	Width (mm)	Nominal Step (mm)	INLET Depth, Di (mm)	OUTLET Depth, Do (mm)	Box gutter A width range (mm)	Box gutter B width (mm)
CSO-200- R	R-200 or CR-200	200	50	150	200	200 to 350	200
CSO-300- R	R-300 or CR-300	300	60	140	200	300 to 450	300
CSO-400- R	R-400 or CR-400	400	70	180	250	400 to 600	400



Product Data Sheet

'Cruciform' Side Outlets XSO-www

Standard sizes to suit any box gutter width between 200mm to 600mm.
Must only be used in combination with a Dam Buster Rainhead

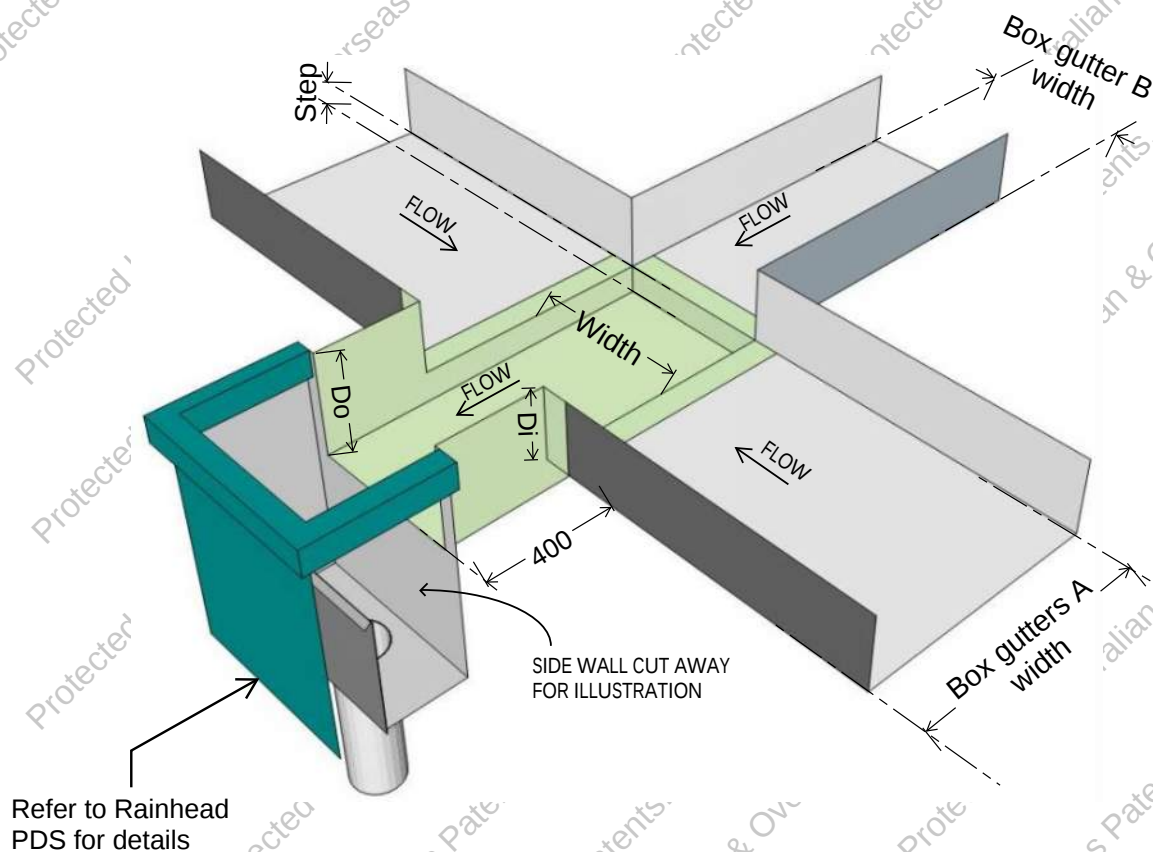

NOTE - The Cruciform Side Outlet may also be used in combination with a Dam Buster Sump - refer to the Standard Details drawings

'Cruciform' Side Outlet dimensions

Side Outlet Size	Rainhead size	Width (mm)	Nominal Step (mm)	INLET Depth, Di (mm)	OUTLET Depth, Do (mm)	Box gutters A width range (mm)	Box gutters B width range (mm)
XSO-200	R-200 or CR-200	200	50	150	200	200 to 350	200
XSO-300	R-300 or CR-300	300	60	140	200	300 to 450	300
XSO-400	R-400 or CR-400	400	70	180	250	400 to 600	400



Product Data Sheet


Sumps SU-www-ddd

Standard sizes to suit box gutter widths of 200mm, 300mm, 400mm, 500mm & 600mm

FULL BLOCKAGE OVERFLOW INDICATOR
(SUPPLIED & INSTALLED BY THE ROOF PLUMBER)
TO BE LOCATED AS SHOWN OR ON EITHER SIDE
OF THE OVERFLOW CHAMBER (REFER ALSO TO
THE STANDARD SUMP DETAIL, DRAWING SD013).

NOTE - SUMP DEFLECTOR COVER

REFER TO THE STANDARD SUMP DRAWINGS
IN THE PRODUCT TECHNICAL STATEMENT FOR
DETAILS OF THE (OPTIONAL) SUMP DEFLECTOR
COVER, WHICH IS INSTALLED ABOVE THE OVERFLOW
COMPARTMENT AND WHICH REDIRECTS 'NUISANCE'
FLOWS INTO THE SUMP COMPARTMENT
CONTAINING THE NORMAL / PRIMARY DOWNPIPE.

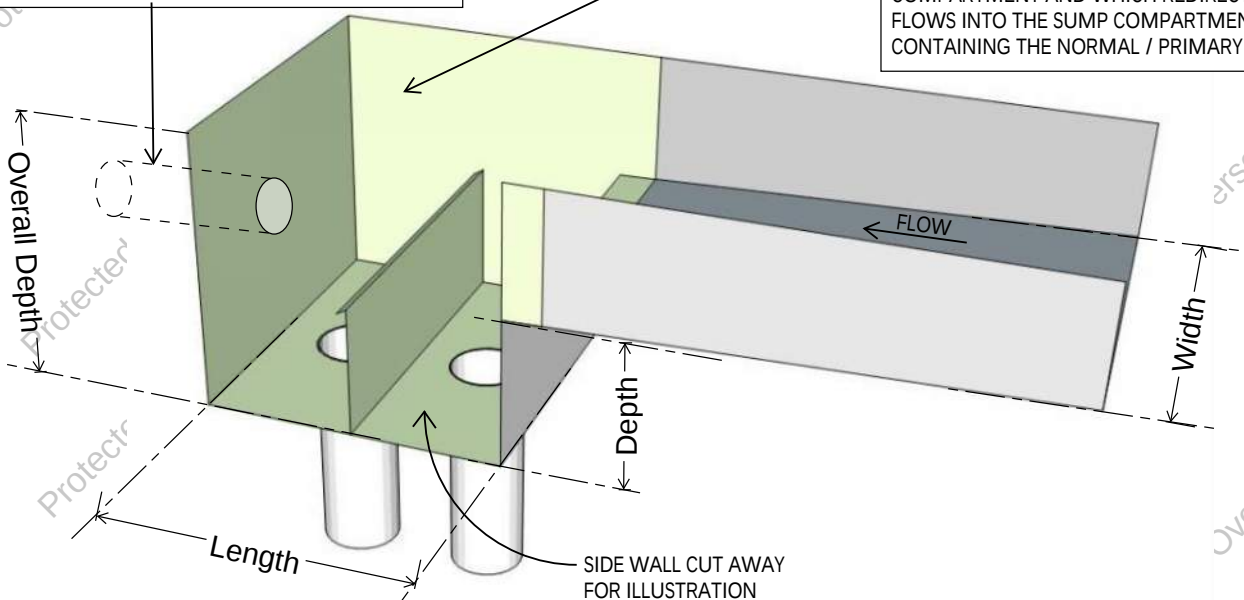

Sump dimensions

Sump size	Width (mm)	Depth (mm)	Length (mm)	Overall Depth (mm)
SU-200-100	205	100	400	300
SU-200-150	205	150	400	350
SU-300-75	305	75	400	280
SU-300-125	305	125	400	330
SU-300-200	305	200	400	405
SU-400-150	405	150	400	400
SU-400-200	405	200	400	450
SU-500-150	505	150	400	300
SU-500-200	505	200	400	400
SU-600-150	605	150	400	300
SU-600-200	605	200	400	400




Product Data Sheet

Continuous Sumps SU-www-ddd*

* Ordered as a Dam Buster Sump

Standard sizes to suit box gutter widths of 200mm, 300mm, 400mm, 500mm & 600mm

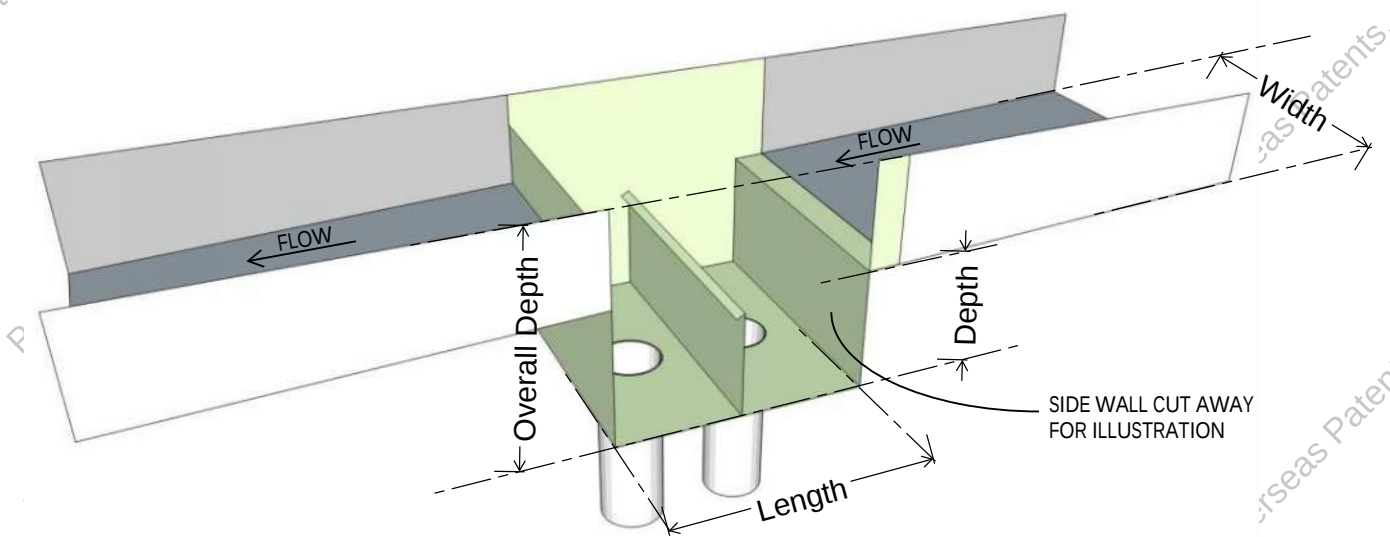

Continuous Sump dimensions


Sump size	Width (mm)	Depth (mm)	Length (mm)	Overall Depth (mm)
SU-200-100	205	100	400	300
SU-200-150	205	150	400	350
SU-300-125	305	125	400	330
SU-300-200	305	200	400	405
SU-400-150	405	150	400	400
SU-400-200	405	200	400	450
SU-500-150	505	150	400	300
SU-500-200	505	200	400	400
SU-600-150	605	150	400	300
SU-600-200	605	200	400	400



Product Data Sheet

Elbows - ELB-www-L

Standard sizes to suit any box gutter width between 200mm to 600mm.

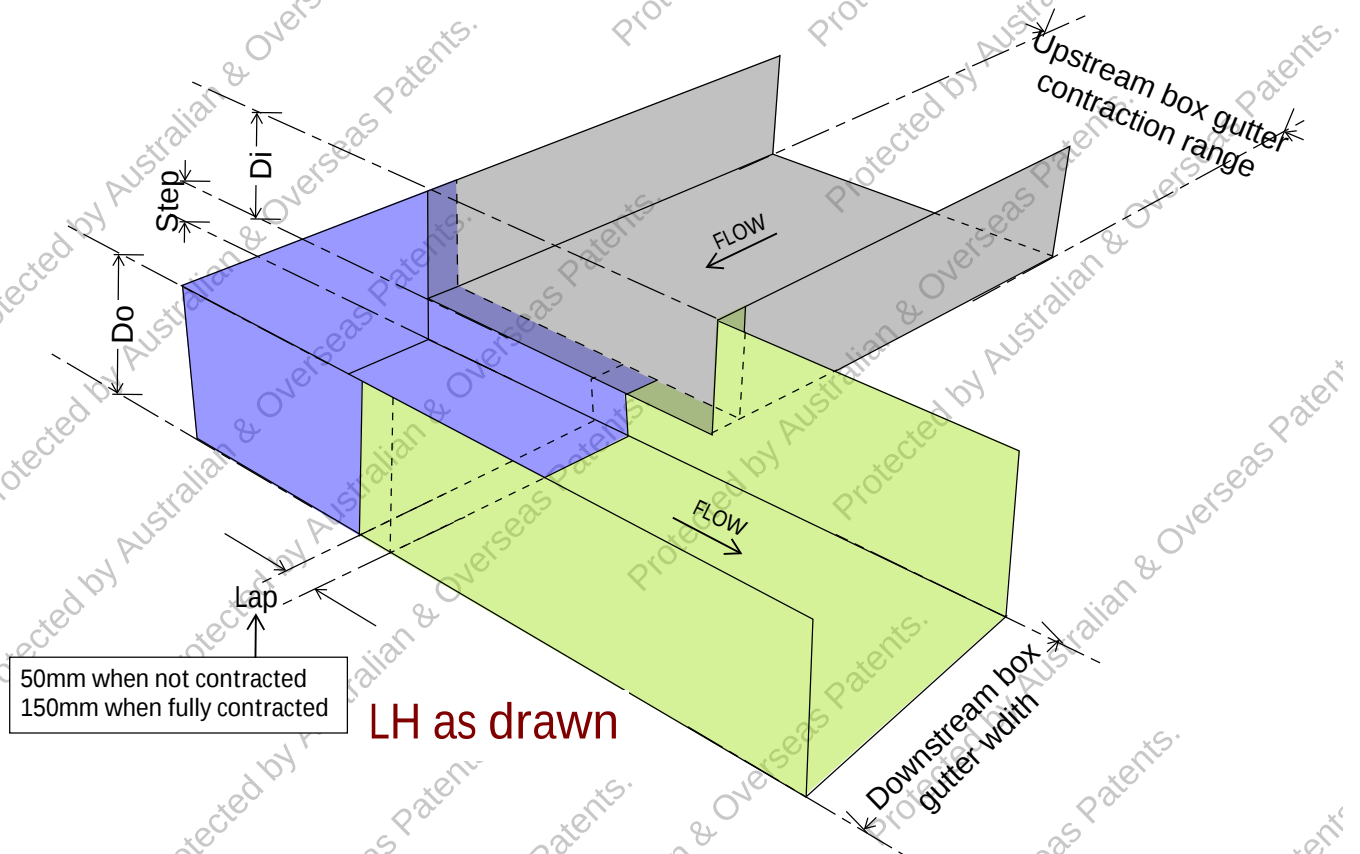

ELBOW dimensions


Elbow size	Upstream Contraction range (mm)	Downstream width (mm)	Nominal Step (mm)	INLET Depth, Di (mm)	OUTLET Depth, Do (mm)
ELB-200- L	200 (fixed)	197	50	180	230
ELB-300- L	200 to 300	297	60	215	275
ELB-400- L	300 to 400	397	70	230	300
ELB-500- L	300 to 500	497	70	230	300
ELB-600- L	400 to 600	597	70	230	300



Product Data Sheet

Elbows - ELB-www-R

Standard sizes to suit any box gutter width between 200mm to 600mm.

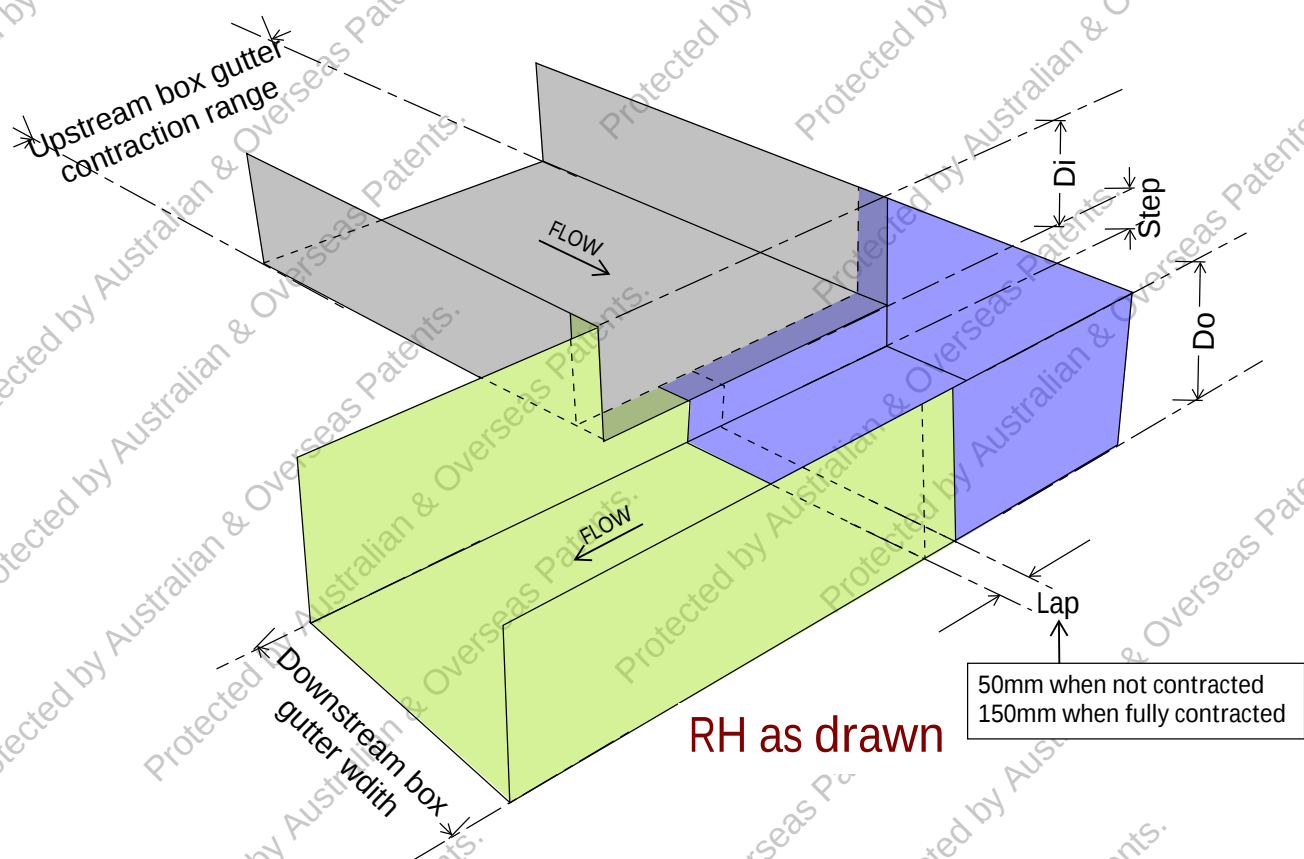

ELBOW dimensions


Elbow size	Upstream Contraction range (mm)	Downstream width (mm)	Nominal Step (mm)	INLET Depth, Di (mm)	OUTLET Depth, Do (mm)
ELB-200- R	200 (fixed)	197	50	180	230
ELB-300- R	200 to 300	297	60	215	275
ELB-400- R	300 to 400	397	70	230	300
ELB-500- R	300 to 500	497	70	230	300
ELB-600- R	400 to 600	597	70	230	300



Product Data Sheet

T Junction TJN-www

Standard sizes to suit any box gutter width between 200mm to 400mm.

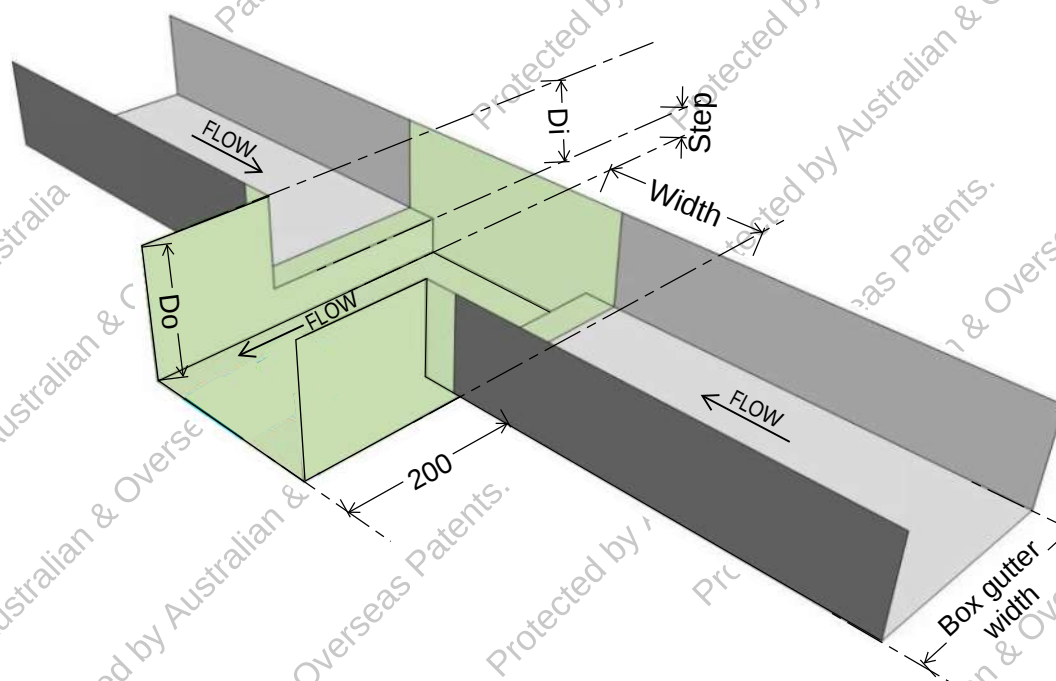

T JUNCTION dimensions


T Junction size	Upstream Contraction range (mm)	Downstream width (mm)	Nominal Step (mm)	INLET Depth, Di (mm)	OUTLET Depth, Do (mm)
TJN-200	200 (fixed)	197	50	180	230
TJN-300	200 to 300	297	60	215	275
TJN-400	300 to 400	397	70	230	300



Product Data Sheet

Corner Junction CJN-www-L

Standard sizes to suit any box gutter width between 200mm to 400mm.

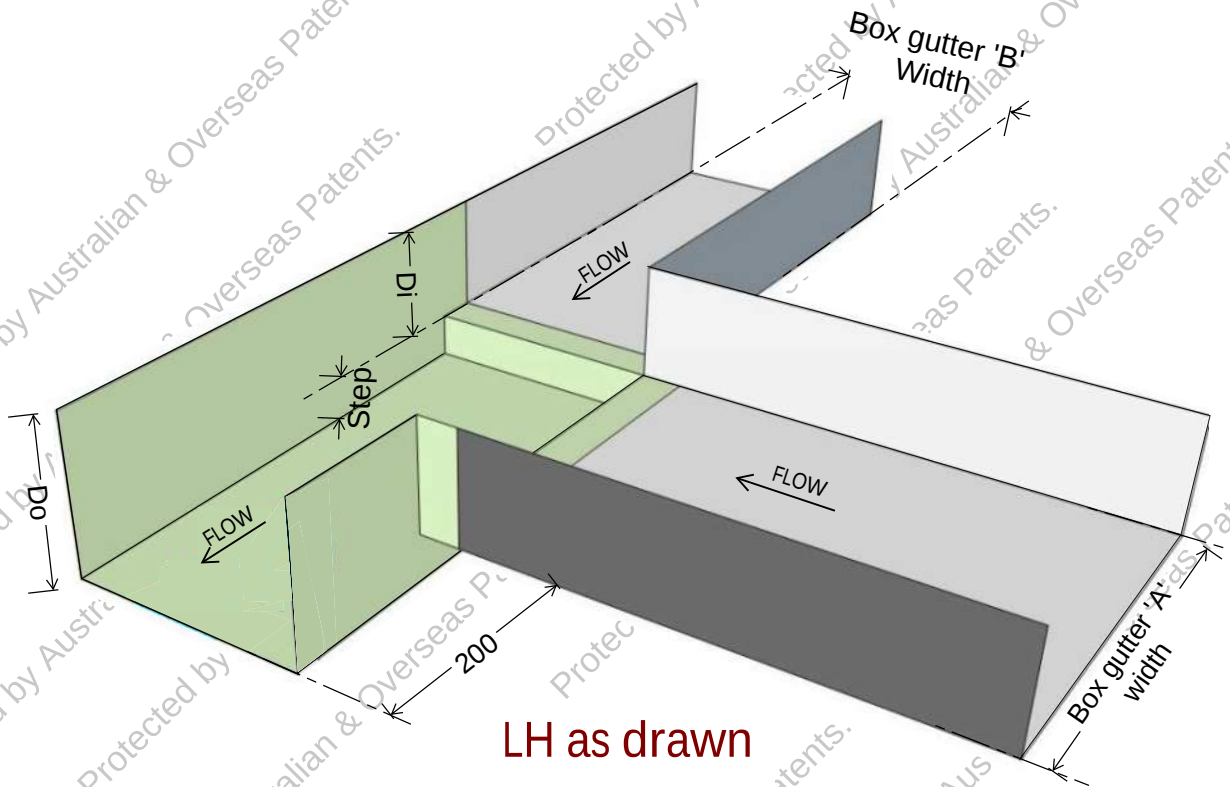

CORNER JUNCTION dimensions


Corner Junction Size	Downstream width (mm)	Nominal Step (mm)	INLET Depth, Di (mm)	OUTLET Depth, Do (mm)	Box gutter A contraction range (mm)	Box gutter B width (mm)
CJN-200-L	197	50	180	230	200	200
CJN-300-L	297	60	215	275	200 to 300	300
CJN-400-L	397	70	230	300	300 to 400	400



Product Data Sheet

Corner Junction CJN-www-R

Standard sizes to suit any box gutter width between 200mm to 400mm.

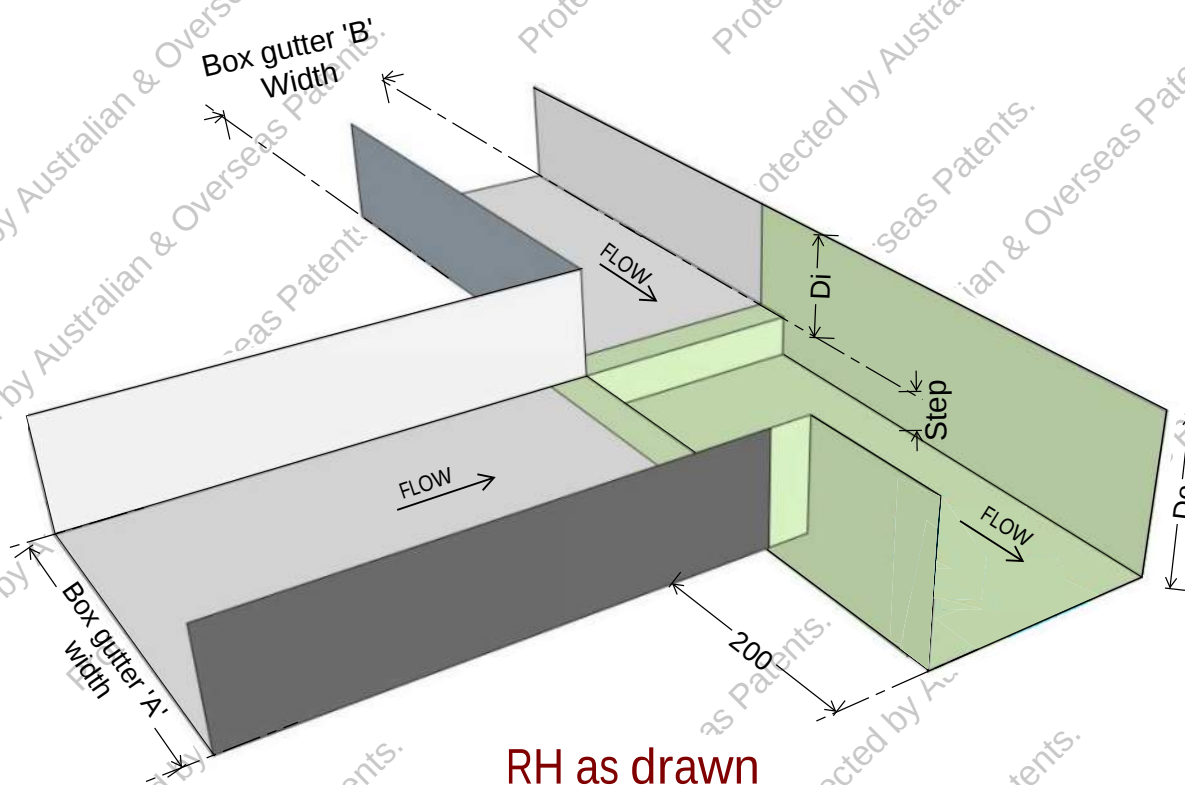


CORNER JUNCTION dimensions

Corner Junction Size	Downstream width (mm)	Nominal Step (mm)	INLET Depth, Di (mm)	OUTLET Depth, Do (mm)	Box gutter A contraction range (mm)	Box gutter B width (mm)
CJN-200-R	197	50	180	230	200	200
CJN-300-R	297	60	215	275	200 to 300	300
CJN-400-R	397	70	230	300	300 to 400	400



Product Data Sheet Flashing Kits

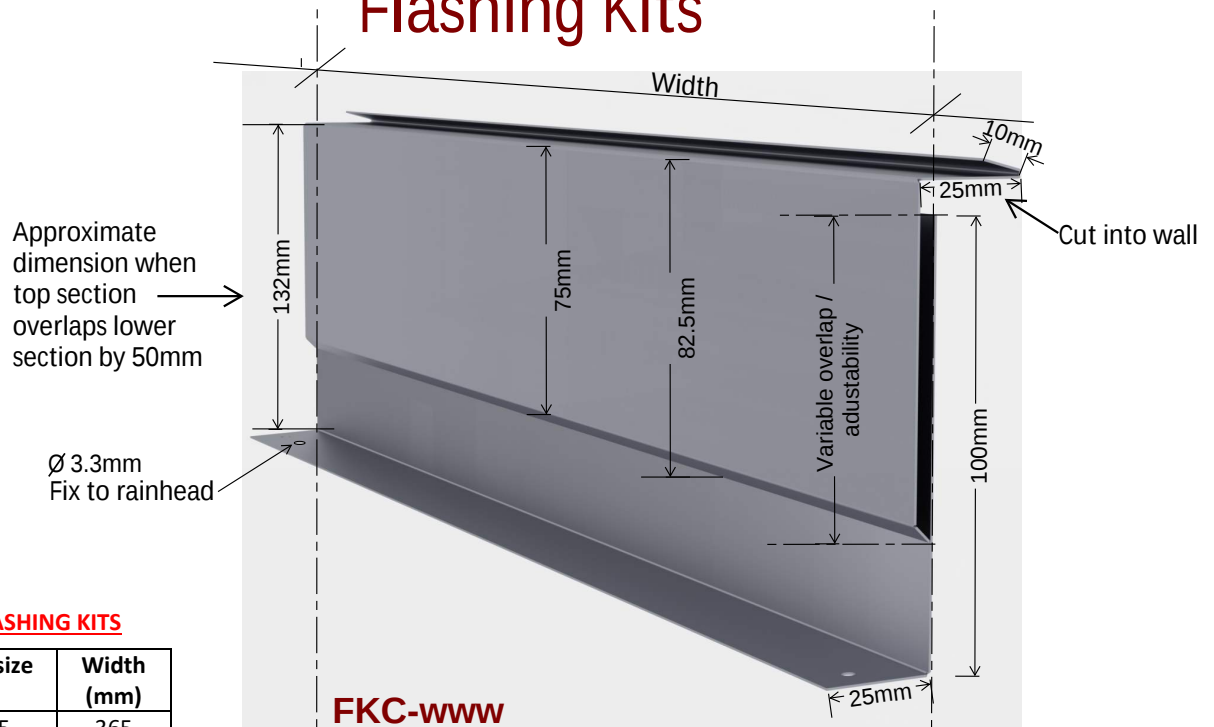


CHASED FLASHING KITS

Flashing size	Width (mm)
FKC-365	365
FKC-465	465
FKC-665	665

FKC-xxx

Flashing Kit - Chased flashing

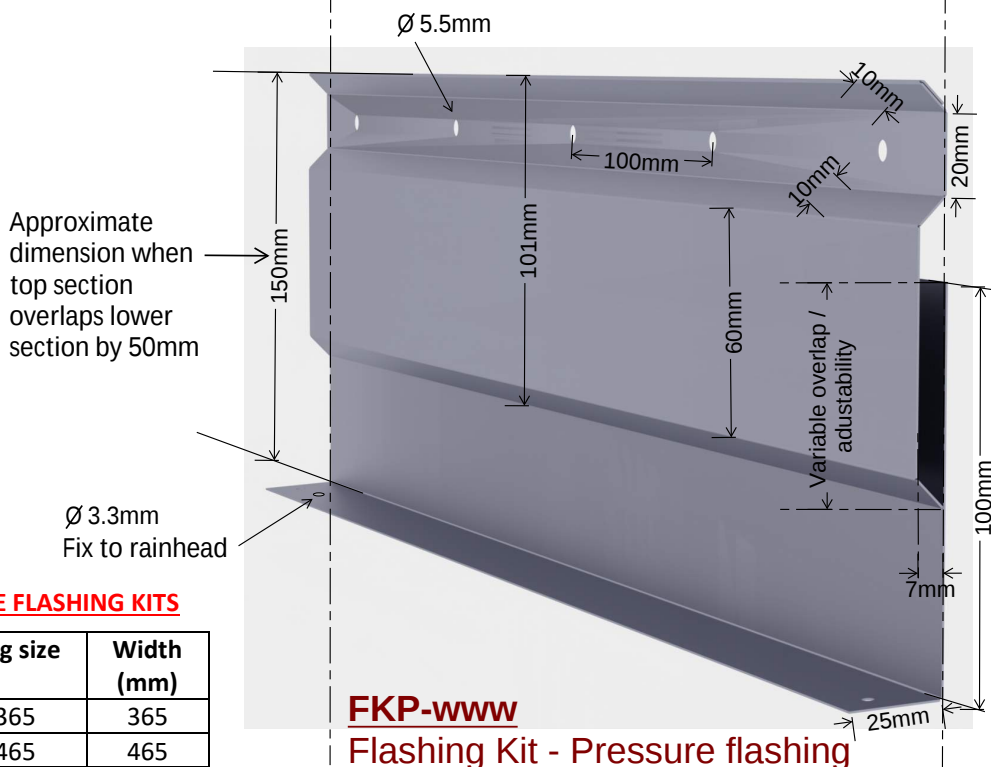

PRESSURE FLASHING KITS

Flashing size	Width (mm)
FKP-365	365
FKP-465	465
FKP-665	665

FKP-xxx

Flashing Kit - Pressure flashing

Sheet Number	Page No.	Title
SD001	45	Typical box gutter discharging to a Dam Buster overflow device
SD002	46	Typical Dam Buster Rainhead
SD003	47	Typical Dam Buster Rainhead – Long & deep box gutter
SD004	48	Typical Overflow Device comprising a Dam Buster Rainhead and a Dam Buster Side Outlet
SD004A	49	Section XX through Side Outlet
SD005	50	Dam Buster T Side Outlet & Rainhead combination
SD006	51	Dam Buster End Side Outlet & Rainhead combination (LH)
SD007	52	Dam Buster Corner Side Outlet & Rainhead combination (LH)
SD008	53	Dam Buster Cruciform Side Outlet & Rainhead combination
SD009	54	Dam Buster T Side Outlet & Sump combination
SD010	55	Dam Buster End Side Outlet & Sump combination (RH)
SD013	56	Typical Dam Buster Sump
SD013A	57	Typical Dam Buster Continuous Sump
SD015	58	Typical Dam Buster Continuous Sump with optional expansion joint
SD015B	59	Section X-X, SD015 – Detail WITH expansion joint
SD0018	60	Dam Buster Elbow (LH)
SD0019	61	Dam Buster Tee Junction
SD0020	62	Dam Buster Corner Junction (LH)

Selected List of Dam Buster Standard Details


Note

Refer to Appendix C of the Product Technical Statement for all standard details

NOTE

All Dam Buster® products are protected by various Australian and International Patents. Refer to www.dambuster.com.au to order, and for the following documents:

- Product Technical Statement
- Evidence of Suitability
- Installation Manual

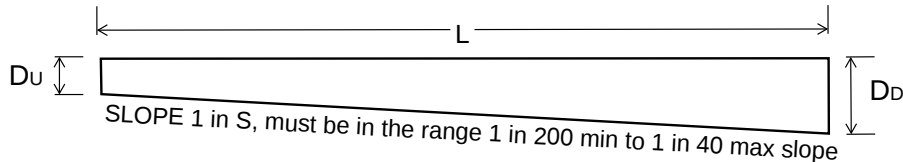**Typical box gutter profile**

Box gutter sizes are specified as:

W_{BG} mm Wide x (D_U MIN to D_D MAX) mm Deep, where:-

W_{BG} = the box gutter width

L = the box gutter length

S = slope (1 in S)


D_U = depth at the upstream end
= minimum design box gutter depth to AS/NZS 3500.3,
(rounded up to nearest 5 mm)

D_D = depth at the downstream end
= the maximum box gutter depth, calculated as
 $D_U + L / S$ (also rounded up to the nearest 5 mm)

NOTES

- 1) All Dam Buster box gutters should be designed for a minimum flow rate of 3L/s and a maximum flow rate of 16L/s
- 2) Where the Engineer's drawings specify the upstream and downstream depths, these values take precedence (however, the slope must be within the range 1 in 200 min to 1 in 40 max).
- 3) Roof plumber to check box gutter length on site, and confirm the downstream depth, D_D provides the required / design slope.
- 4) The roof plumber may increase the downstream depth, D_D as necessary, however, the minimum depth at the upstream end, D_U , cannot be reduced (and the fall must not exceed 1 in 40).
- 5) For buildings constructed in reactive clay soils, consideration should be given to increasing the box gutter slope in order to allow for potential building movements due to differential changes in foundation soil moisture contents. Dam Buster recommends a minimum slope of 1 in 150 for reactive clay sites.

SD001 - Typical box gutter discharging to a Dam Buster overflow device (NTS)

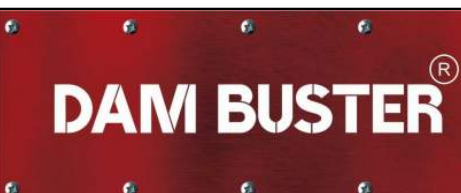 Dam Buster Pty Ltd www.dambuster.com.au orders@dambuster.com.au		DESIGNED	DRAWN
	TITLE: Standard Details Sheets	CHECKED	
		SCALE NTS @A4	REVISION
		DATE 01.07.2026	5
		JOB No.	SHEET No. SD001

NOTE

The 150mm minimum only applies for a straight box gutter discharging to a Dam Buster rainhead. For the **Dam Buster Side Outlet** and **Rainhead** combinations, the short 'outlet' box gutter is **DEEPER** and requires a **DEEPER** penetration in the parapet wall. Refer to Side Outlet details.

Trim walls of box gutter receiver to equal box gutter depth at downstream end, however, maintain 150mm minimum height through the parapet wall

Dam Buster Chute Lid / flashing*, installed **WITHIN** the box gutter (sold separately).
* This flashing forms part of the box gutter (not the rainhead) and may instead be folded up on site by roof plumber. Note that Chute Lids are only supplied with Dam Buster Side Outlets.
Note - Fold up Chute Lid at parapet wall and rivet and silicone to hanging flashing.

Hanging flashing recommended

3 deg inwards fall

Parapet capping, installed in accordance with SA HB39

External / parapet wall

Dam Buster rainhead as specified

Box gutter as specified

NOTE

Dam Buster recommends a minimum clearance height through the parapet wall as part of Dam Buster's risk minimization strategy.

Box gutter receiver

Note
All laps must be in the direction of flow

Dam Buster Rainhead sizes

MR-200, R-200, R-300, R-400, R-500 & R-600

Dam Buster Stretched & Widened Rainheads

Refer Product Names for available sizes

Dam Buster Curved Rainhead sizes

MCR-200, CR-200, CR-300, CR-400, CR-500 & CR-600

Dam Buster Rainhead & Curved Rainhead

SD002 - Typical Dam Buster Rainhead (NTS)

NOTES

1. Refer to the current Dam Buster P/L technical manual for installation details

DAM BUSTER®

Dam Buster Pty Ltd
www.dambuster.com.au
orders@dambuster.com.au

TITLE: Standard Details Sheets

DESIGNED	DRAWN
CHECKED	
SCALE NTS @A4	REVISION
DATE 01.07.2026	5
JOB No.	SHEET No.
	SD002

Trim top of box gutter to level of top of rainhead / box gutter receiver.

NOTES

- 1) The box gutter receiver depth has been set such that it will always exceed the minimum design depth of the box gutter (provided the design flow rate of the Dam Buster rainhead is not exceeded).
- 2) This situation can occur for a long box gutter, which is deep at the downstream end due to the fall in the gutter, and noting that the design / minimum box gutter depth must be provided at the upstream end.

Dam Buster Chute Lid / flashing*, installed **WITHIN** the box gutter (sold separately).

* This flashing forms part of the box gutter (not the rainhead) and may instead be folded up on site by roof plumber. Note that Chute Lids are only supplied with Dam Buster Side Outlets.

Note - Fold up Chute Lid at parapet wall and rivet and silicone to hanging flashing.

Hanging flashing recommended

3 deg inwards fall

Parapet capping, installed in accordance with SA HB39

External / parapet wall

Dam Buster rainhead as specified

Box gutter as specified

Box gutter receiver

Note
All laps must be in the direction of flow

Dam Buster Rainhead sizes

MR-200, R-200, R-300, R-400, R-500 & R-600

Dam Buster Curved Rainhead sizes

MCR-200, CR-200, CR-300, CR-400, CR-500 & CR-600

Dam Buster Stretched & Widened Rainheads

Refer Product Names for available sizes

Overflow condition

Normal flow condition

Downpipe as specified

Note
All laps must be in the direction of flow

Dam Buster Rainhead & Curved Rainhead

SD003 - Typical Dam Buster Rainhead - Long & deep box gutter (NTS)

NOTES

1. Refer to SD002 for all details not noted


DAM BUSTER®

Dam Buster Pty Ltd
www.dambuster.com.au
orders@dambuster.com.au

TITLE: Standard Details Sheets


DESIGNED	DRAWN
CHECKED	
SCALE NTS @A4	REVISION 5
DATE 01.07.2026	
JOB No.	SHEET No.
	SD003

Note- the Side Outlet depth has been pre-engineered such that it is at least as deep as the minimum design (upstream) box gutter depth

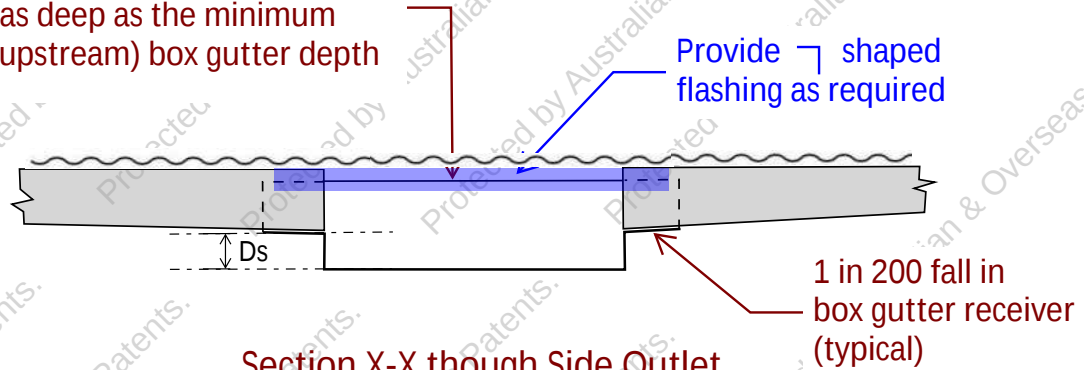

Section X-X though Side Outlet
Box gutter(s) deeper than Side Outlet

Side Outlet Width	Side Outlet Depth 'Ds'
200 mm	50 mm
300 mm	60 mm
400 mm	70 mm

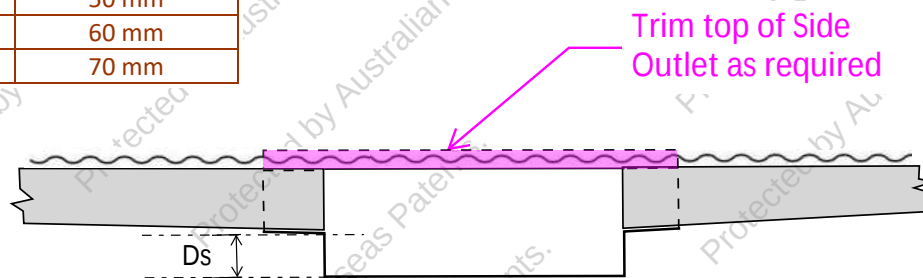

Section X-X though Side Outlet
Side Outlet deeper than Box gutter(s)

SD004A - Typical Overflow Device comprising a
Dam Buster Rainhead and a Dam Buster Side Outlet (NTS)

NOTES

1. Refer to the current Dam Buster P/L technical manual for installation details

DAM BUSTER[®]

Dam Buster Pty Ltd
www.dambuster.com.au
orders@dambuster.com.au

TITLE: Standard Details Sheets

DESIGNED	DRAWN
CHECKED	
SCALE NTS @A4	REVISION
DATE 01.07.2026	5
JOB No.	SHEET No.
	SD004A

Note


Where the deep outlet box gutter exceeds the depth of the rainhead box gutter receiver, the outlet box gutter may be cut down to match the depth of the box gutter receiver.

The penetration in the parapet wall should always match the depth of the box gutter receiver for the rainhead series i.e.
 200mm series - 200mm
 300mm series - 200mm
 400mm series - 250mm

Dam Buster Chute Lid / flashing through external parapet wall, installed WITHIN the short, deep outlet box gutter (i.e. such that Chute Lid sides are placed inside the box gutter and not external to the box gutter).

Note

All laps must be in the direction of flow

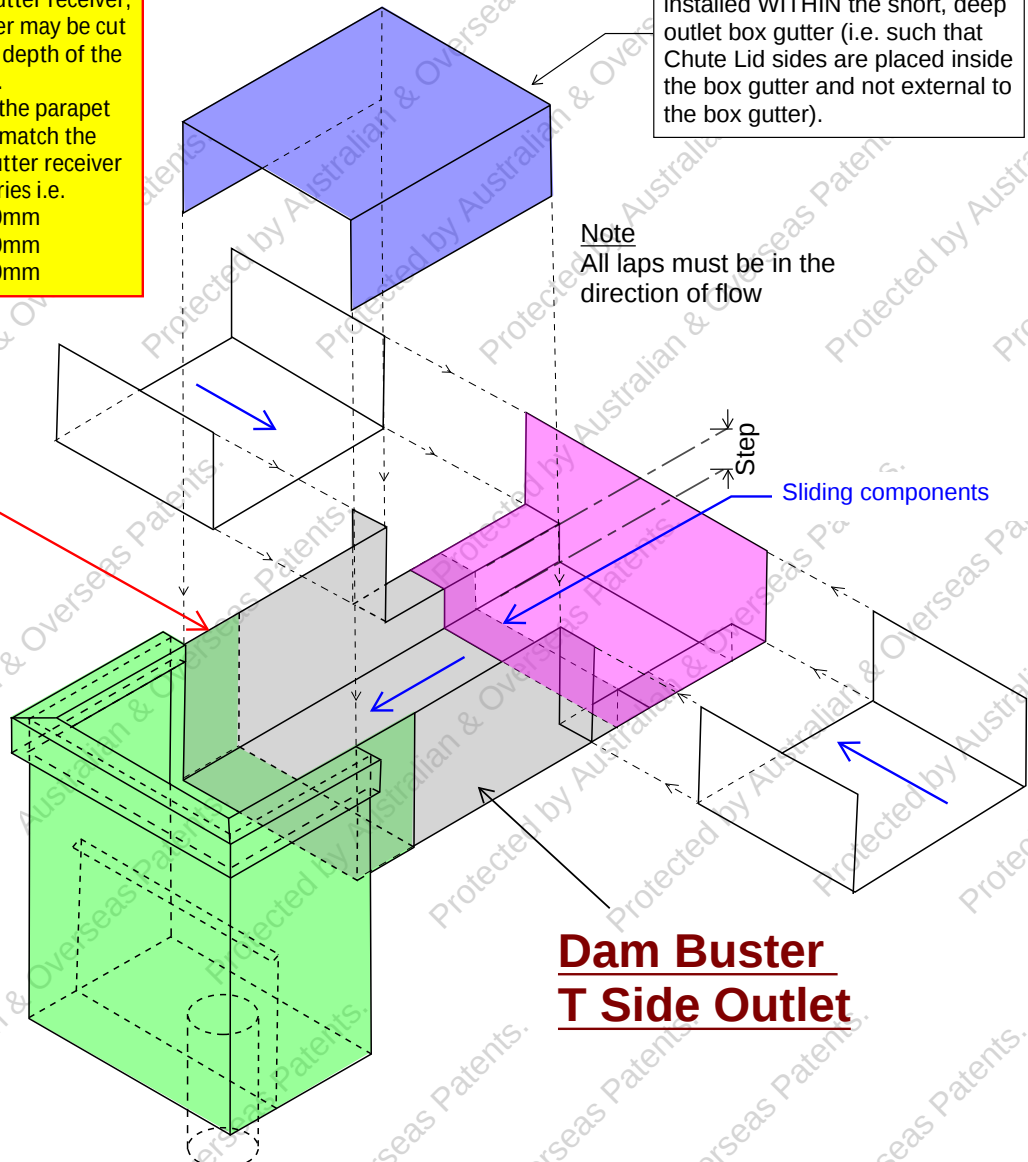

Dam Buster Rainhead

Dam Buster T Side Outlet

T Side Outlet Size	Side Outlet Width	Nominal Step	Rainhead size	Side Outlet Expansion range
TSO-200	200 mm	50mm	R-200 or CR-200	200 to 350 mm
TSO-300	300 mm	60mm	R-300 or CR-300	300 to 450 mm
TSO-400	400 mm	70mm	R-400 or CR-400	400 to 600 mm

SD005 - Dam Buster T Side Outlet & Rainhead combination (NTS)

NOTES

1. Refer to the current Dam Buster manual for installation details

DAM BUSTER®

Dam Buster Pty Ltd
www.dambuster.com.au
orders@dambuster.com.au

TITLE: Standard Details Sheets

DESIGNED	DRAWN
CHECKED	
SCALE NTS @A4	REVISION 5
DATE 01.07.2026	
JOB No.	SHEET No. SD005

Note

Where the deep outlet box gutter exceeds the depth of the rainhead box gutter receiver, the outlet box gutter may be cut down to match the depth of the box gutter receiver.


The penetration in the parapet wall should always match the depth of the box gutter receiver for the rainhead series i.e.

200mm series - 200mm

300mm series - 200mm

400mm series - 250mm

Dam Buster Chute Lid / flashing through external parapet wall, installed WITHIN the short, deep outlet box gutter (i.e. such that Chute Lid sides are placed inside the box gutter and not external to the box gutter).

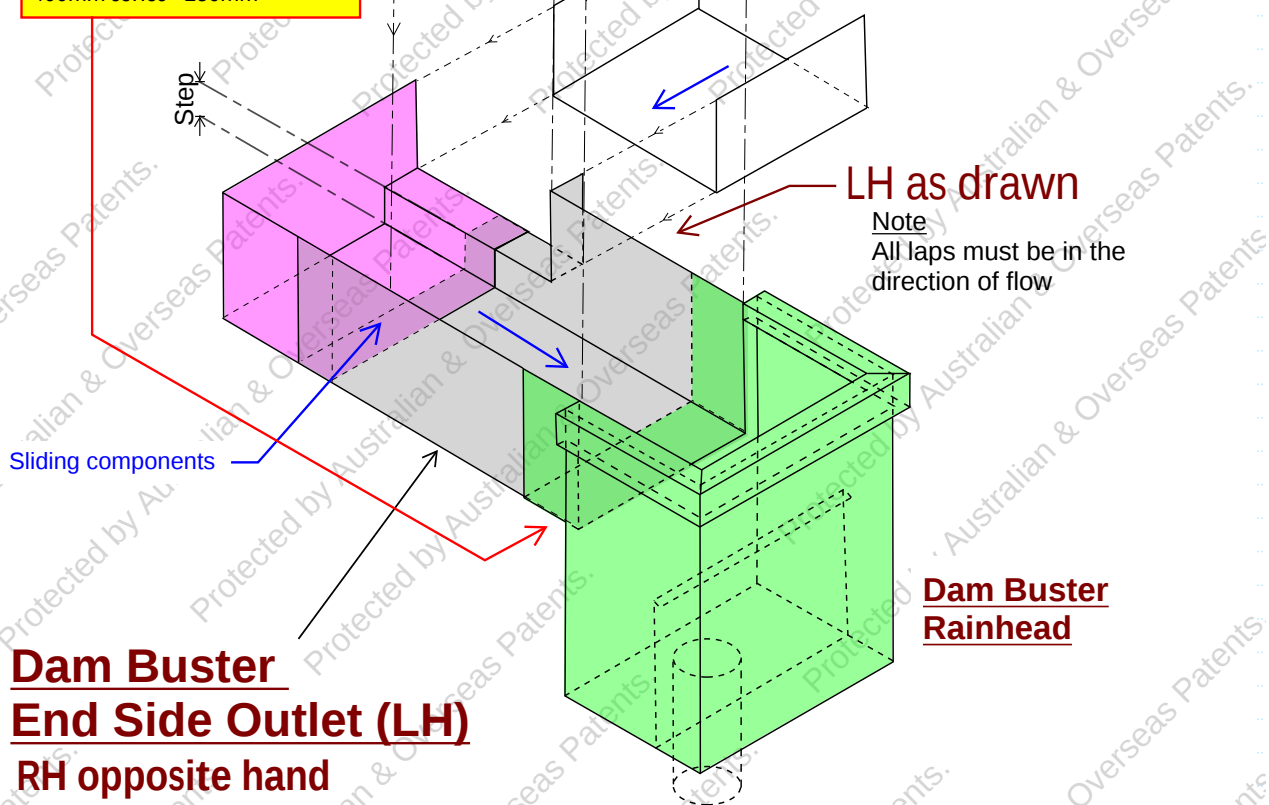

Dam Buster **End Side Outlet (LH)** **RH opposite hand**

End Side Outlet Size	Side Outlet Width	Nominal Step	Rainhead size	Side Outlet Expansion range
ESO-200-L	200 mm	50mm	R-200 or CR-200	200 to 350 mm
ESO-300-L	300 mm	60mm	R-300 or CR-300	300 to 450 mm
ESO-400-L	400 mm	70mm	R-400 or CR-400	400 to 600 mm

SD006 - Dam Buster End Side Outlet & Rainhead combination (NTS)

NOTES

1. Refer to the current Dam Buster manual for installation details


DAM BUSTER®

Dam Buster Pty Ltd
www.dambuster.com.au
orders@dambuster.com.au

TITLE: Standard Details Sheets

DESIGNED	DRAWN
CHECKED	
SCALE NTS @A4	REVISION
DATE 01.07.2026	5
JOB No.	SHEET No.
	SD006

Dam Buster Chute Lid / flashing through external parapet wall, installed WITHIN the short, deep outlet box gutter (i.e. such that Chute Lid sides are placed inside the box gutter and not external to the box gutter).

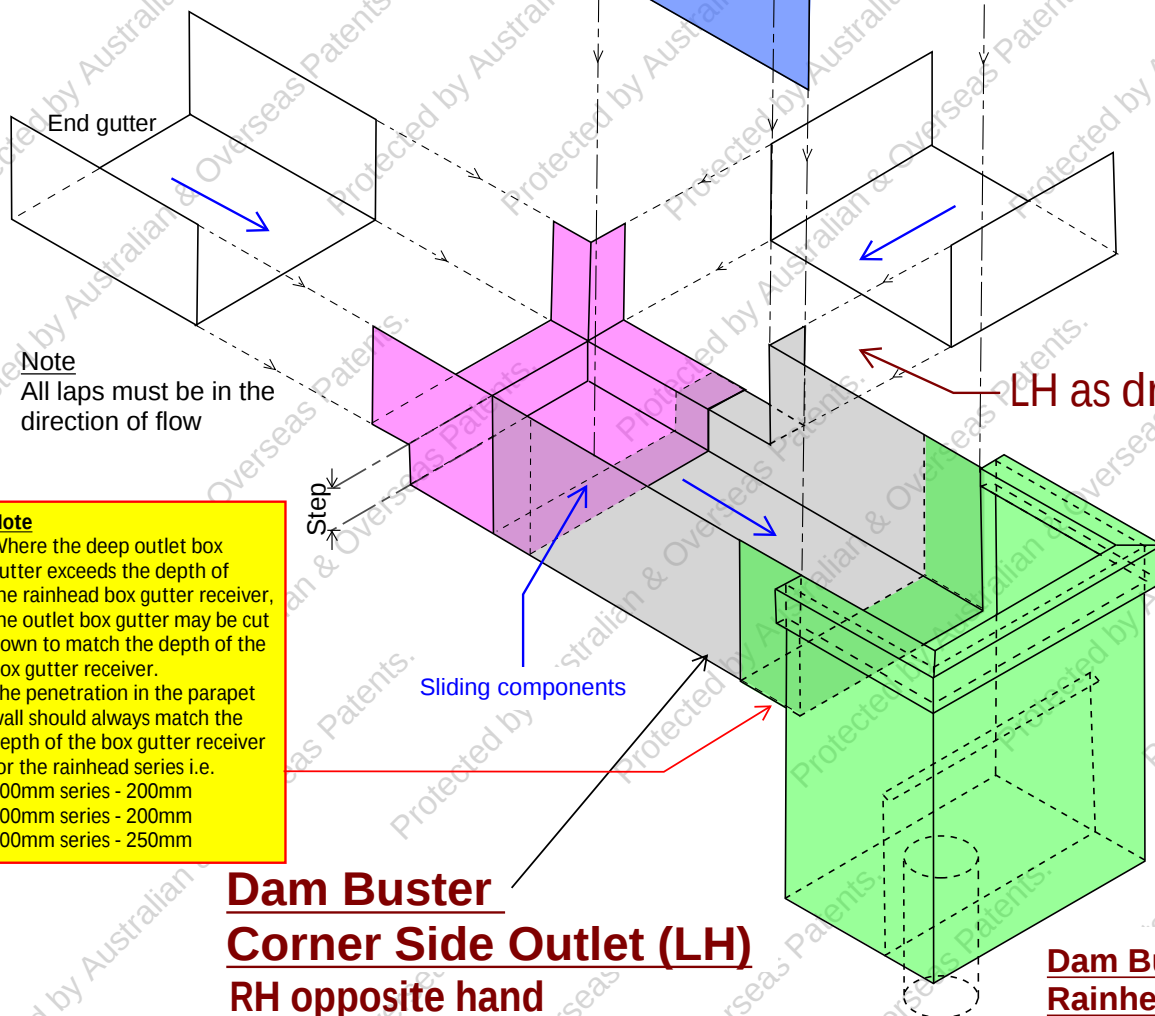

Corner Side Outlet Size	Side Outlet Width	Nominal Step	Rainhead size	Side Outlet Expansion range	End Box Gutter Width
CSO-200-L	200 mm	50mm	R-200 or CR-200	200 to 350 mm	200 mm
CSO-300-L	300 mm	60mm	R-300 or CR-300	300 to 450 mm	300 mm
CSO-400-L	400 mm	70mm	R-400 or CR-400	400 to 600 mm	400 mm

SD007 - Dam Buster Corner Side Outlet & Rainhead combination (NTS)

NOTES

1. Refer to the current Dam Buster manual for installation details

DAM BUSTER®

Dam Buster Pty Ltd
www.dambuster.com.au
orders@dambuster.com.au

TITLE: Standard Details Sheets

DESIGNED	DRAWN
CHECKED	
SCALE NTS @A4	REVISION
DATE 01.07.2026	5
JOB No.	SHEET No.
	SD007

Note

Where the deep outlet box gutter exceeds the depth of the rainhead box gutter receiver, the outlet box gutter may be cut down to match the depth of the box gutter receiver.

The penetration in the parapet wall should always match the depth of the box gutter receiver for the rainhead series i.e.

200mm series - 200mm

300mm series - 200mm

400mm series - 250mm

Dam Buster Chute Lid / flashing through external parapet wall, installed WITHIN the short, deep outlet box gutter (i.e. such that Chute Lid sides are placed inside the box gutter and not external to the box gutter).

Sliding components

End gutter

Note

All laps must be in the direction of flow

**Dam Buster
Rainhead**

**Dam Buster
Cruciform Side Outlet**

Cruciform Side Outlet Size	Side Outlet Width	Nominal Step	Rainhead size	Side Outlet Expansion range	End Box Gutter Width
XSO-200	200 mm	50mm	R-200 or CR-200	200 to 350 mm	200 mm
XSO-300	300 mm	60mm	R-300 or CR-300	300 to 450 mm	300 mm
XSO-400	400 mm	70mm	R-400 or CR-400	400 to 600 mm	400 mm

SD008 - Dam Buster Cruciform Side Outlet & Rainhead combination (NTS)

NOTES

1. Refer to the current Dam Buster manual for installation details

DAM BUSTER®

Dam Buster Pty Ltd
www.dambuster.com.au
orders@dambuster.com.au

TITLE: Standard Details Sheets

DESIGNED	DRAWN
CHECKED	
SCALE NTS @A4	REVISION
DATE 01.07.2026	5
JOB No.	SHEET No.
	SD008

Protected by various Australian and International Patents

Dam Buster Chute Lid / flashing through external parapet wall, installed WITHIN the short, deep outlet box gutter (i.e. such that Chute Lid sides are placed inside the box gutter and not external to the box gutter).

Note
All laps must be in the direction of flow

Sliding components

NOTE
Refer to the Dam Buster Sump detail for optional Sump Deflector Cover to prevent nuisance flows entering the overflow chamber. Sized to sump width. Sold separately.

Dam Buster Sump

90mm Diam. Overflow Indicator pipe supplied & installed by roof plumber. Note, the Indicator pipe can be alternatively installed to the side of the sump. Refer to Dam Buster Sump detail.

Dam Buster T Side Outlet

T Side Outlet Size	Side Outlet Width	Nominal Step	Sump size	Side Outlet Expansion range
TSO-200	200 mm	50mm	SU-200-100 or SU-200-150	200 to 350 mm
TSO-300	300 mm	60mm	SU-300-125 or SU-300-200	300 to 450 mm
TSO-400	400 mm	70mm	SU-400-150 or SU-400-200	400 to 600 mm

SD009 - Dam Buster T Side Outlet & Sump combination (NTS)

NOTES

- 1. Refer to the current Dam Buster manual for installation details



Dam Buster Pty Ltd
www.dambuster.com.au
orders@dambuster.com.au

TITLE: Standard Details Sheets

DESIGNED	DRAWN
CHECKED	
SCALE NTS @A4	REVISION 5
DATE 01.07.2026	
JOB No.	SHEET No.
	SD009

NOTE
Refer to the Dam Buster Sump detail for optional Sump Deflector Cover to prevent nuisance flows entering the overflow chamber

Dam Buster Sump

90mm Diam. Overflow Indicator pipe supplied & installed by roof plumber.
Note, the Indicator pipe can be alternatively installed to the side of the sump.
Refer to Dam Buster Sump detail.

Dam Buster Chute Lid / flashing through external parapet wall, installed **WITHIN** the short, deep outlet box gutter (i.e. such that Chute Lid sides are placed inside the box gutter and not external to the box gutter).

RH as drawn

Note
All laps must be in the direction of flow

Sliding components

Dam Buster End Side Outlet (RH) **LH opposite hand**

End Side Outlet Size	Side Outlet Width	Nominal Step	Sump size	Side Outlet Expansion range
ESO-200-(L or R)	200 mm	50mm	SU-200-100 or SU-200-150	200 to 350 mm
ESO-300-(L or R)	300 mm	60mm	SU-300-125 or SU-300-200	300 to 450 mm
ESO-400-(L or R)	400 mm	70mm	SU-400-150 or SU-400-200	400 to 600 mm

SD010 - Dam Buster End Side Outlet & Sump combination (NTS)

NOTES


1. Refer to the current Dam Buster manual for installation details

DAM BUSTER®

Dam Buster Pty Ltd
www.dambuster.com.au
orders@dambuster.com.au

TITLE: Standard Details Sheets

DESIGNED	DRAWN
CHECKED	
SCALE NTS @A4	REVISION 5
DATE 01.07.2026	
JOB No.	SHEET No.
	SD010

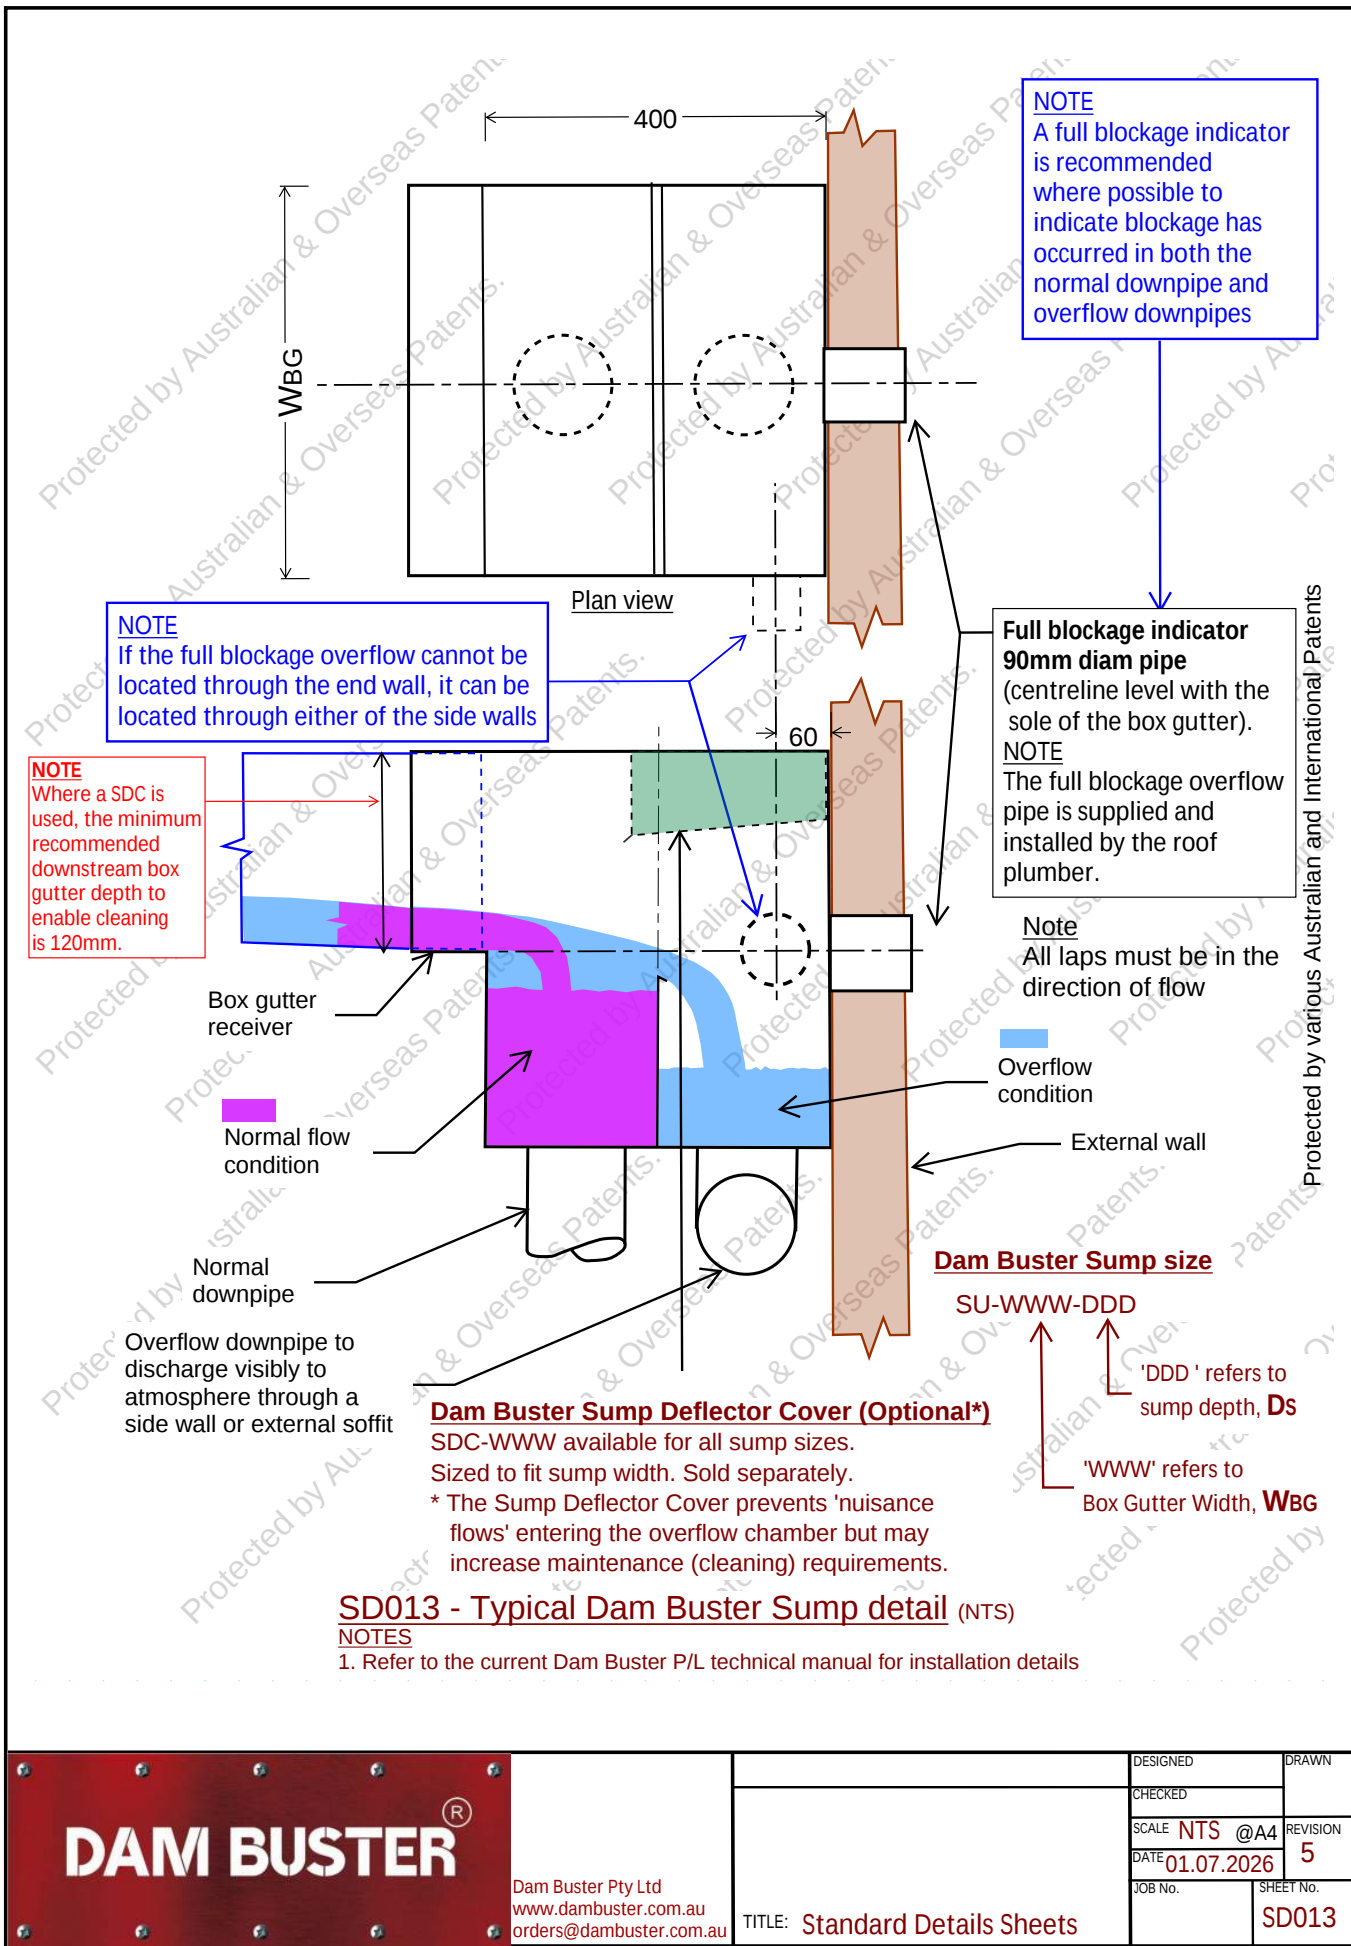

DAM BUSTER®

Dam Buster Pty Ltd
www.dambuster.com.au
orders@dambuster.com.au



TITLE: Standard Details Sheets

DESIGNED	DRAWN
CHECKED	
SCALE: NTS @A4	REVISION: 5
DATE: 01.07.2026	
JOB No.	SHEET No.
	SD013


Protected by various Australian and International Patents

NOTE
Where SDCs are used:
(i) Cut out end wall of downstream box gutter for a depth of 60mm
(ii) Cut corners of SDC and fold down over reduced box gutter end wall.

DAM BUSTER JOINER
PLATES BOTH SIDES
TO INNER FACES.




NOTE
A full blockage overflow
indicator is recommended
where possible. Refer to
typical (non-continuous)
Sump detail.

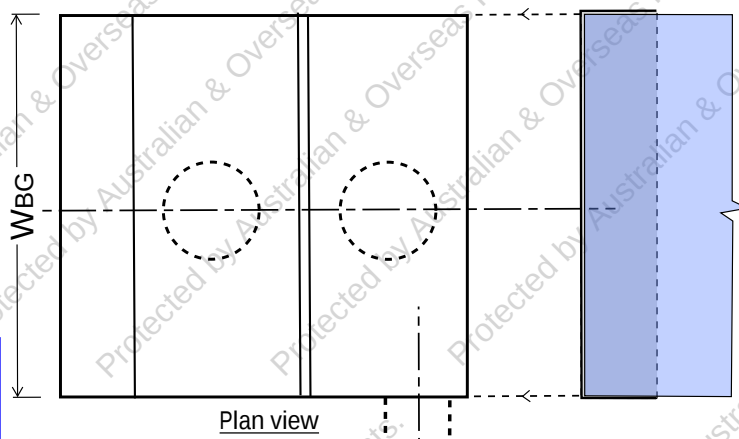


Plan view

NOTE
Where a SDC is
used, the minimum
recommended
downstream box
gutter depth to
enable cleaning
is 120mm.

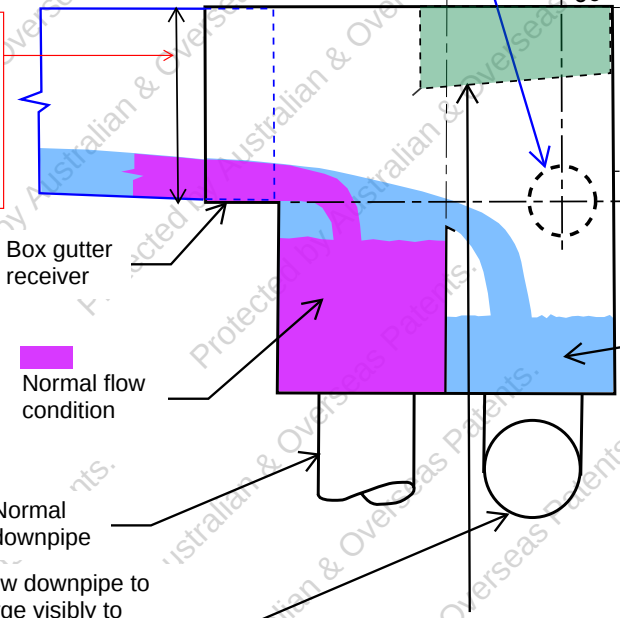

Downstream box gutter,
refer SD015 for details



Downstream box gutter
receiver, refer SD015

Overflow
condition

Note
All laps must be in the
direction of flow

Dam Buster Sump size

SU-**WWW**-**DDD**

'DDD' refers to
sump depth, **Ds**

'WWW' refers to
Box Gutter Width, **WBG**

Dam Buster Sump Deflector Cover (Optional*)

SDC-**WWW** available for all sump sizes.
Sized to fit sump width. Sold separately.

* The Sump Deflector Cover prevents 'nuisance
flows' entering the overflow chamber but may
increase maintenance (cleaning) requirements.

SD013A - Typical Continuous Dam Buster Sump detail (NTS)

NOTES


1. Refer to the current Dam Buster P/L technical manual for installation details

DAM BUSTER®

Dam Buster Pty Ltd
www.dambuster.com.au
orders@dambuster.com.au

CLIENT:	DESIGNED	DRAWN
PROJECT:	CHECKED	
ADDRESS:	SCALE NTS @A4	REVISION
TITLE: Standard Details Sheets	DATE 01.07.2026	5
	JOB No.	SHEET No.
		SD013A

Note
Refer to the Sump detail for the **Sump Deflector Cover ('SDC')** to prevent nuisance flows from entering the overflow chamber

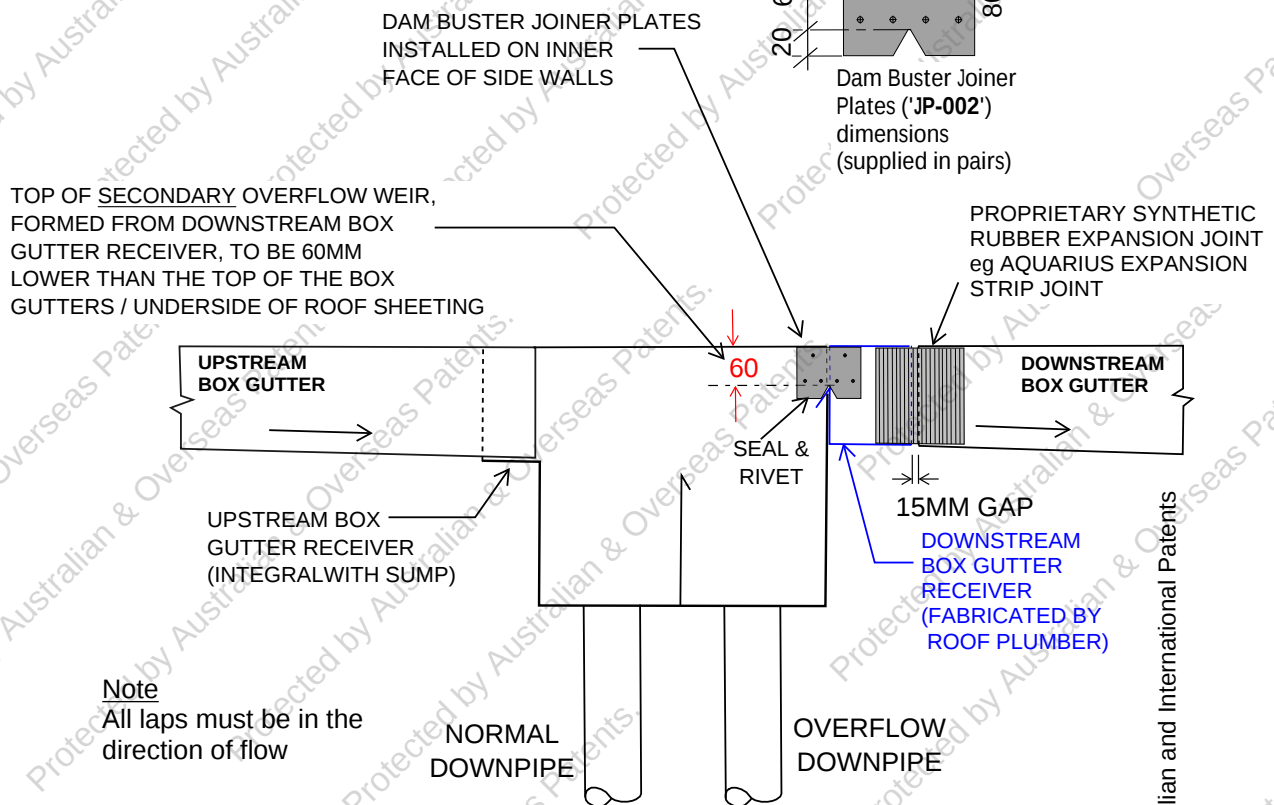

SD0015B - Section X-X, SD0015
(Dam Buster Continuous Sump, as installed
WITH expansion joint)

Protected by various Australian and International Patents

DAM BUSTER®

Dam Buster Pty Ltd
www.dambuster.com.au
orders@dambuster.com.au

TITLE: Standard Details Sheets

DESIGNED	DRAWN
CHECKED	
SCALE NTS @A4	REVISION
DATE 01.07.2026	5
JOB No.	SHEET No.
	SD015B

Note

Elbows have in-built tapers to ensure that lapping is in the correct direction of flow.

Protected by various Australian and International Patents

Step

Upstream
box gutter

Contraction
range

Note

All laps must be in the direction of flow

LH as drawn

Sliding components allow for contraction of upstream box gutter width i.e., smaller upstream box gutter width transitioning to larger downstream box gutter width.

Downstream
box gutter

Dam Buster Elbow (LH) **RH opposite hand**

Dam Buster Elbow

Dam Buster Elbow size	Upstream Contraction range (mm)	Downstream box gutter width	Nominal Step
ELB-200-L	200 (fixed) mm	200 mm	50 mm
ELB-300-L	200 to 300 mm	300 mm	60 mm
ELB-400-L	300 to 400 mm	400 mm	70 mm
ELB-500-L	400 to 500 mm	500 mm	70 mm
ELB-600-L	400 to 600 mm	600 mm	70 mm

SD018 - Dam Buster Elbow (NTS)

NOTES


1. Refer to the current Dam Buster manual for installation details

DAM BUSTER®

Dam Buster Pty Ltd
www.dambuster.com.au
orders@dambuster.com.au

TITLE: Standard Details Sheets

DESIGNED	DRAWN
CHECKED	
SCALE NTS @A4	REVISION
DATE 01.07.2026	5
JOB No.	SHEET No.
	SD018

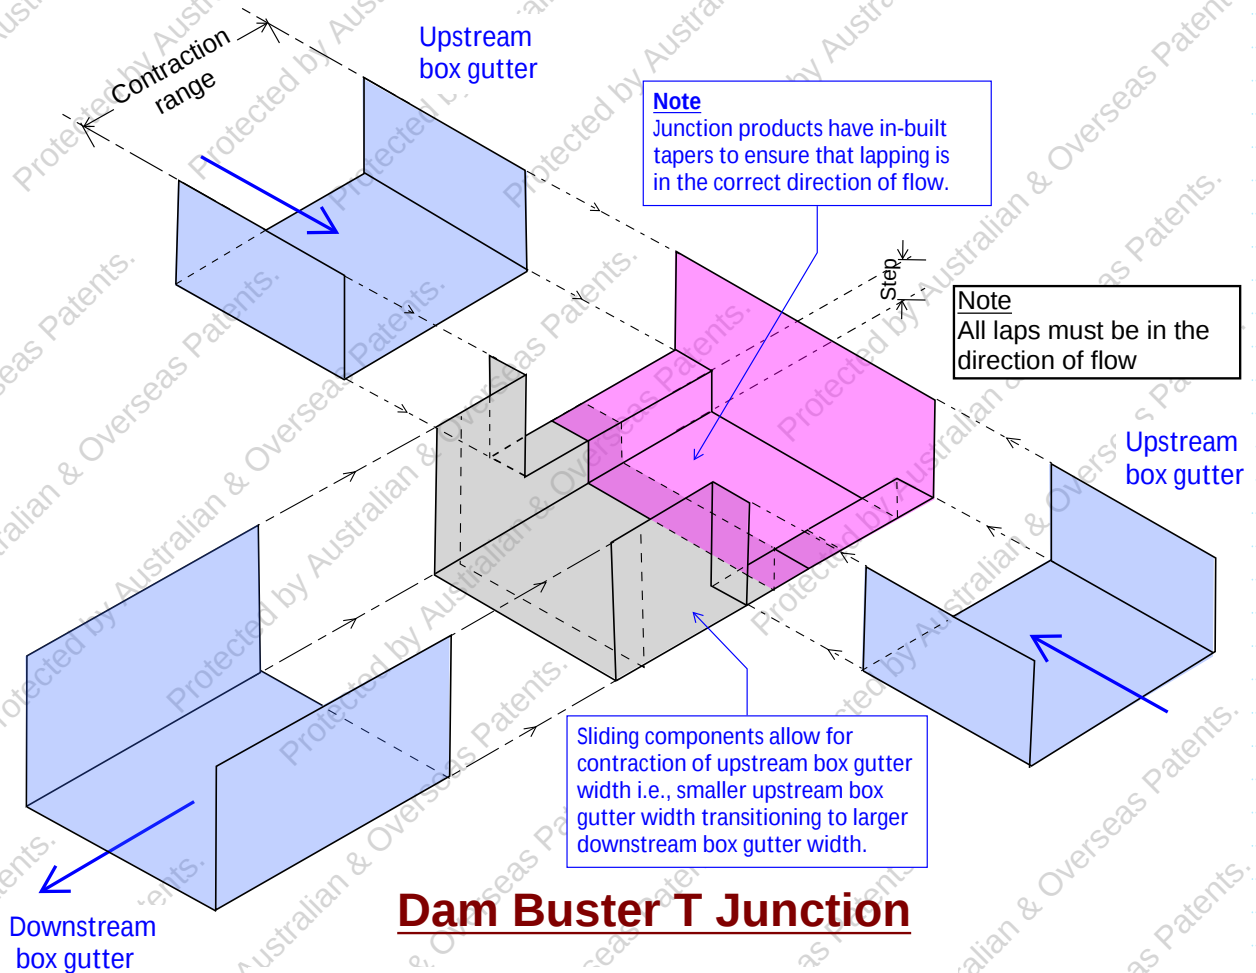

Dam Buster T Junction

Junction size	Upstream Contraction range	Downstream width	Nominal Step
TJN-200	200 (fixed) mm	200 mm	50 mm
TJN-300	200 to 300 mm	300 mm	60 mm
TJN-400	300 to 400 mm	400 mm	70 mm

SD019 - Dam Buster T Junction (NTS)

NOTES


1. Refer to the current Dam Buster manual for installation details

DAM BUSTER®

Dam Buster Pty Ltd
www.dambuster.com.au
orders@dambuster.com.au

TITLE: Standard Details Sheets

DESIGNED	DRAWN
CHECKED	
SCALE NTS @A4	REVISION 5
DATE 01.07.2026	
JOB No.	SHEET No. SD019

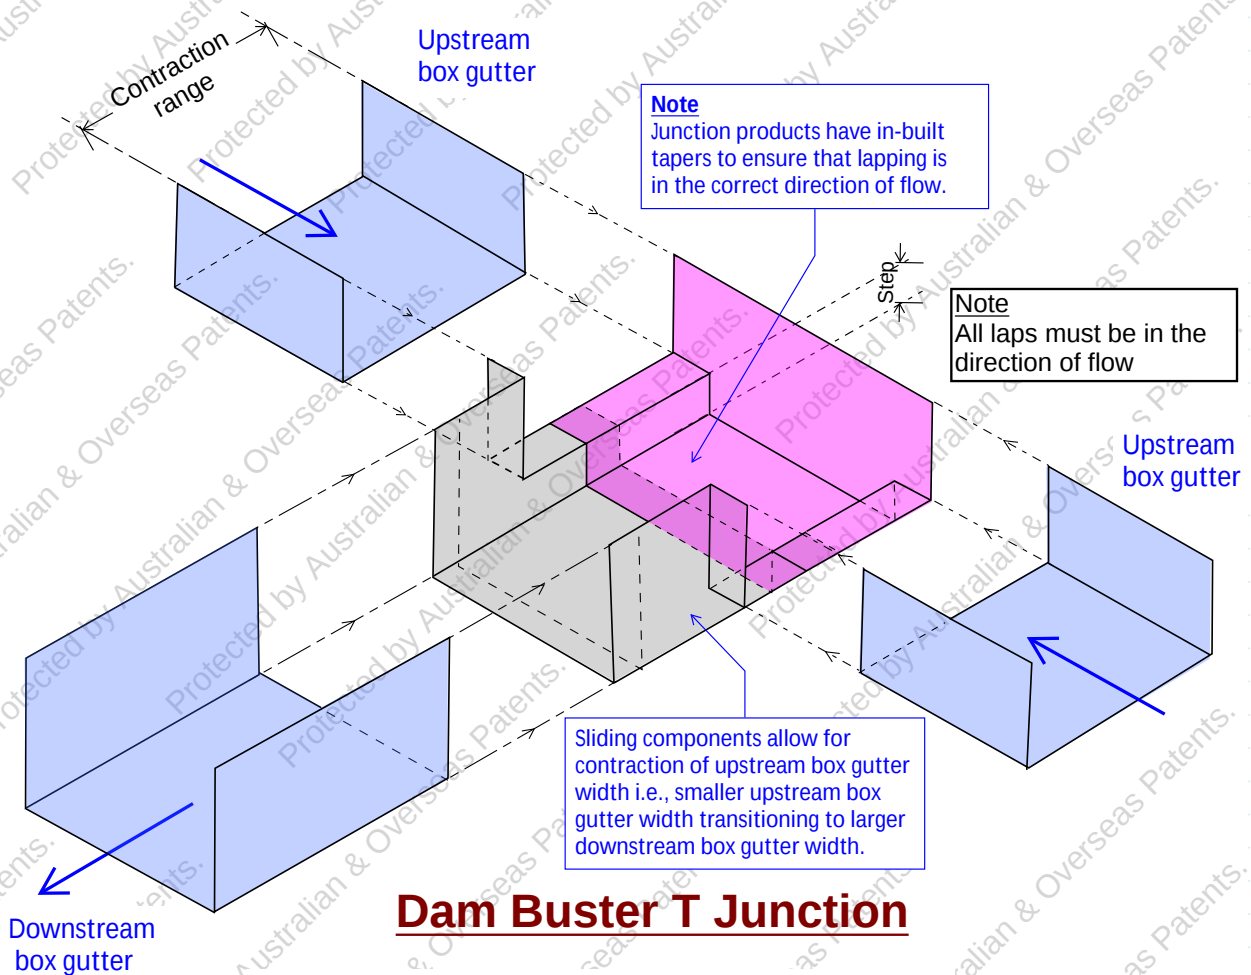

Dam Buster T Junction

Dam Buster T Junction

Junction size	Upstream Contraction range	Downstream width	Nominal Step
TJN-200	200 (fixed) mm	200 mm	50 mm
TJN-300	200 to 300 mm	300 mm	60 mm
TJN-400	300 to 400 mm	400 mm	70 mm

SD019 - Dam Buster T Junction (NTS)

NOTES

1. Refer to the current Dam Buster manual for installation details

DAM BUSTER®

Dam Buster Pty Ltd
www.dambuster.com.au
orders@dambuster.com.au

TITLE: Standard Details Sheets

DESIGNED	DRAWN
CHECKED	
SCALE NTS @A4	REVISION 5
DATE 01.07.2026	
JOB No.	SHEET No.
	SD019